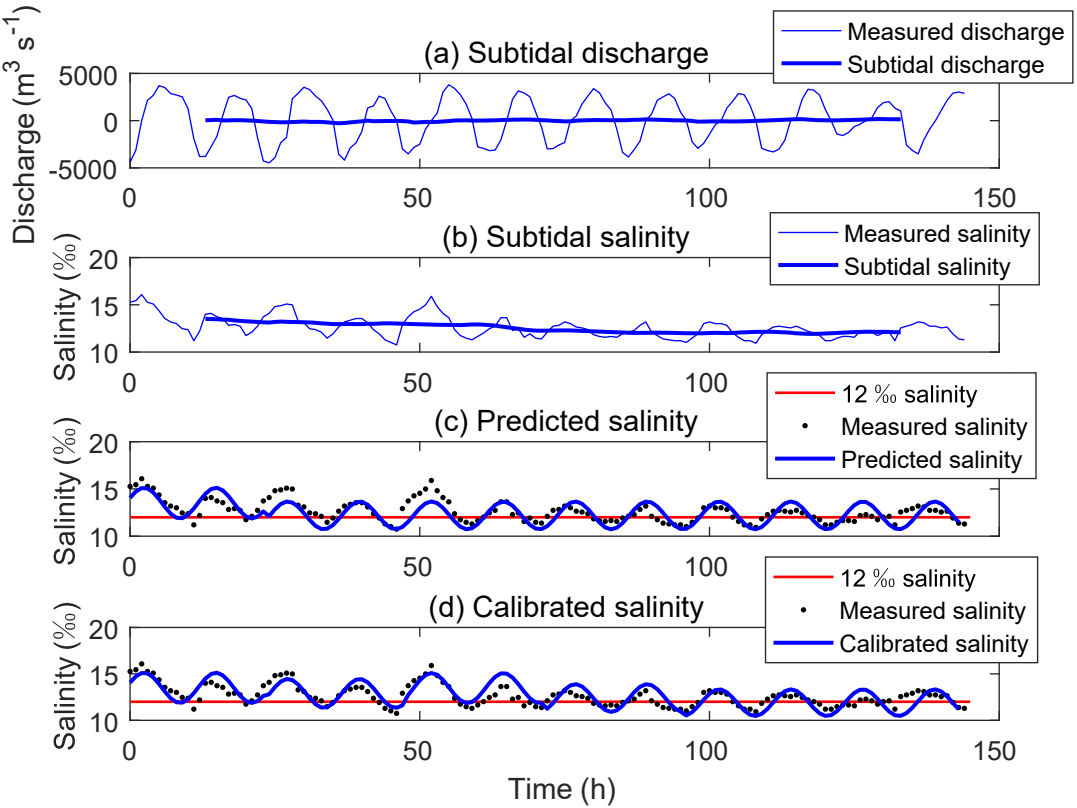
(a) Subtidal discharge
Measured discharge
Subtidal discharge
Discharge (m3 s-1)
5000
0
-5000
(b) Subtidal salinity
Measured salinity
Subtidal salinity
Salinity (‰)
20
15
10
(c) Predicted salinity
12 ‰ salinity
Measured salinity
Predicted salinity
(d) Calibrated salinity
12 ‰ salinity
Measured salinity
Calibrated salinity
0
50
100
150
Time (h)