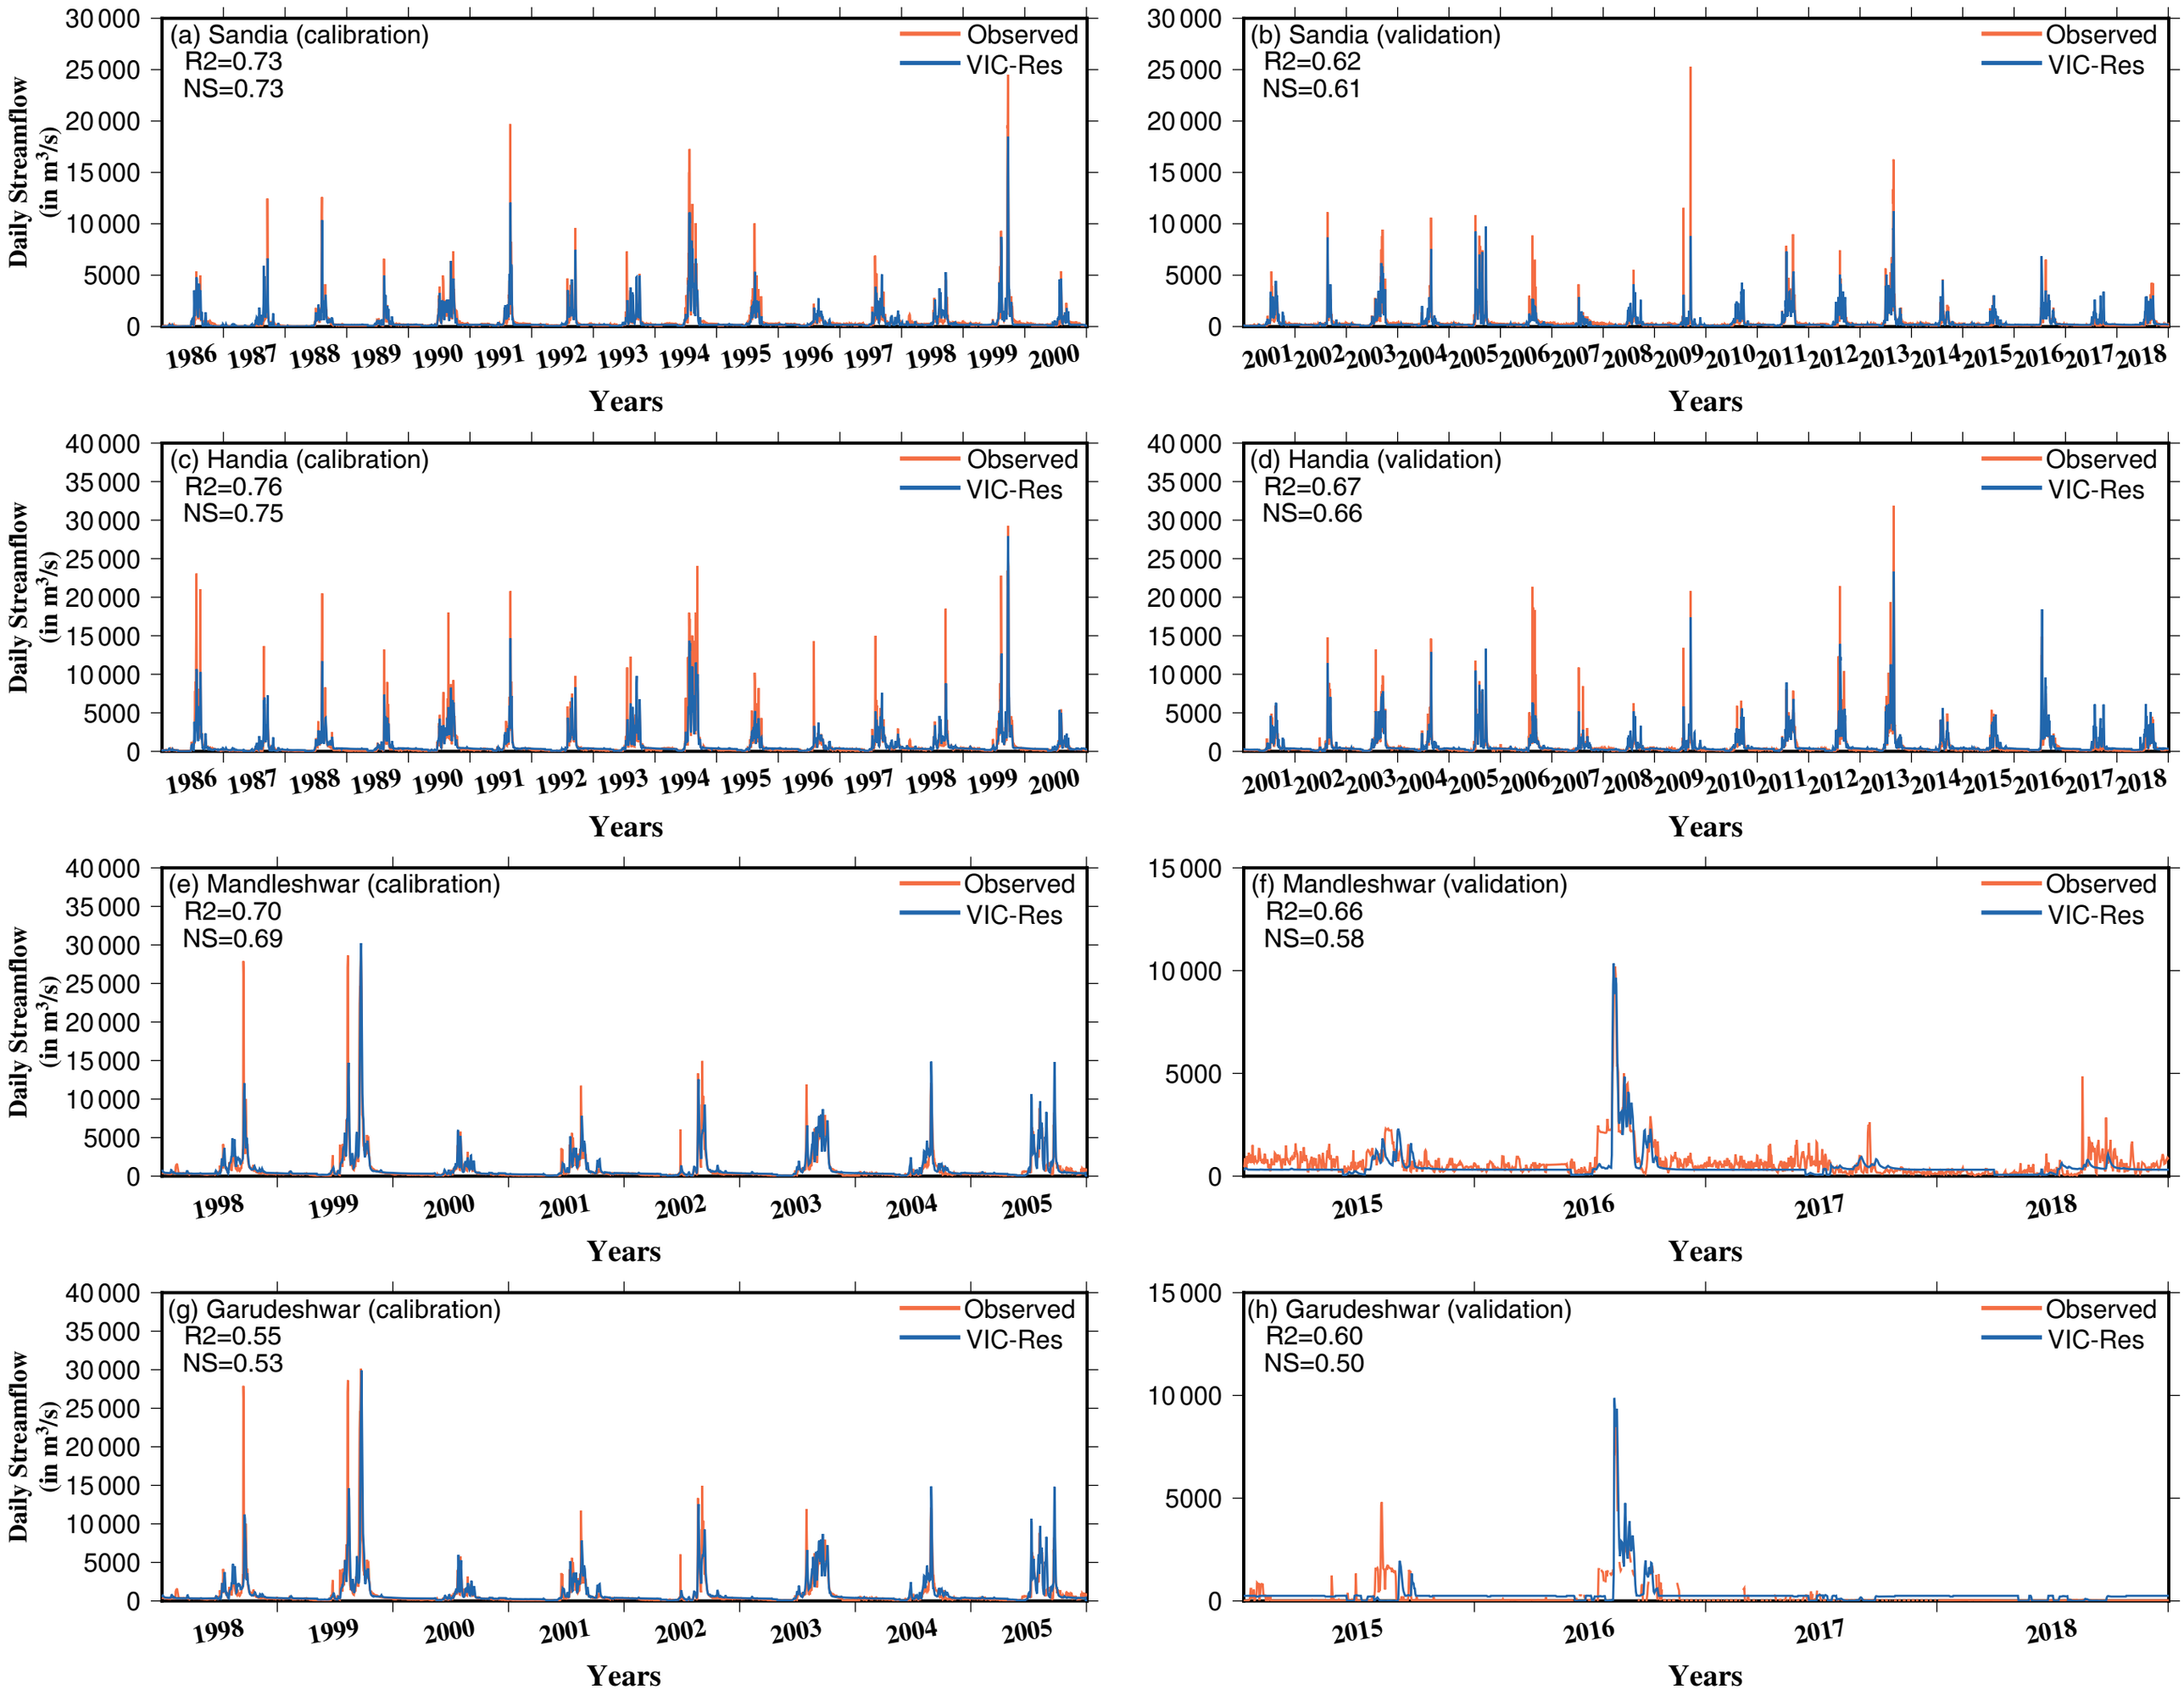
(a) Sandia (calibration)
R2=0.73
NS=0.73
(b) Sandia (validation)
R2=0.62
NS=0.61
(c) Handia (calibration)
R2=0.76
NS=0.75
(d) Handia (validation)
R2=0.67
NS=0.66
(e) Mandleshwar (calibration)
R2=0.70
NS=0.69
(f) Mandleshwar (validation)
R2=0.66
NS=0.58
(g) Garudeshwar (calibration)
R2=0.55
NS=0.53
(h) Garudeshwar (validation)
R2=0.60
NS=0.50
Observed
VIC-Res
Daily Streamflow (in m3/s)
Years