

Improving inflow forecasting into hydropower reservoirs through a complementary modelling framework

A. S. Gragne¹, A. Sharma², R. Mehrotra² and K. Alfredsen¹

[1]{Department of Hydraulic and Environmental Engineering, Norwegian University of Science and Technology, Trondheim, Norway}

[2]{School of Civil and Environmental Engineering, The University of New South Wales, Sydney, Australia}

Abstract

Accuracy of reservoir inflow forecasts is instrumental for maximizing the value of water resources and benefits gained through hydropower generation. Improving hourly reservoir inflow forecasts over a 24 hour lead-time is considered within the day-ahead (Elspot) market of the Nordic exchange market. A complementary modelling framework presents an approach for improving real-time forecasting without needing to modify the pre-existing forecasting model, but instead formulating an independent additive or complementary model that captures the structure the existing operational model may be missing. We present here application of this principle for issuing improved hourly inflow forecasts into hydropower reservoirs over extended lead-times, and the parameter estimation procedure reformulated to deal with bias, persistence and heteroscedasticity. The procedure presented comprises an error model added on top of an un-alterable constant parameter conceptual model, the models being demonstrated with reference to the 207 km² Krinsvatn catchment in central Norway. The structure of the error model is established based on attributes of the residual time series from the conceptual model. Besides improving forecast skills of operational models, the approach estimates the uncertainty in the complementary model structure and produces probabilistic inflow forecasts that entrain suitable information for reducing uncertainty in the decision-making processes in hydropower systems operation. Deterministic and probabilistic evaluations revealed an overall significant improvement in forecast accuracy for lead-times up to 17 hours. Season based evaluations indicated that the improvement in inflow forecasts varies across seasons and inflow forecasts

1 in autumn and spring are less successful with the 95% prediction interval bracketing less than
2 95% of the observations for lead-times beyond 17 hours.

3

4 **1 Introduction**

5 Hydrologic models can deliver information useful for management of natural resources and
6 natural hazards (Beven, 2009). They are important components of hydropower planning and
7 operation schemes where it is essential to estimate future reservoir inflows and quantify the
8 water available for power production on a daily basis. The identification and representation of
9 the significant responses of hydrologic systems have been diverse among hydrologists.
10 Different hydrologists have incorporated their perceptions of the functioning of hydrologic
11 systems into their models and come up with several rival models; some of them process based
12 and others data-based (for thorough reviews of the historic development of hydrologic
13 modelling refer to Todini, 2007 and Beven, 2012). These models can be grouped in to two main
14 classes, conceptual and data-driven models.

15 Lumped conceptual hydrologic models are the most commonly used models in operational
16 forecasting. Models of this class use sets of mathematical expressions to provide a simplified
17 generalization of the complex natural processes of the hydrologic systems in the headwater
18 areas of reservoirs. Application of such models conventionally requires estimating the model
19 parameters by conditioning to observed hydrologic data. Unlike conceptual models, data-driven
20 models establish mathematical relationship between input and output data without any explicit
21 attempt to represent the physical processes of the hydrologic system. Reconciling the two
22 modelling approaches and combining the advantages of both approaches (Todini, 2007), has
23 produced some example applications in forecasting systems where the two modelling
24 approaches are harmoniously used for improving reliability of hydrologic model outputs (e.g.
25 Abebe and Price, 2003 and Solomatine and Shrestha, 2009).

26 Usefulness of a model for operational prediction is determined by the level of accuracy to which
27 the model reproduces observed hydrologic behaviour of the study area. In operational
28 applications, evaluation of how well the models capture rainfall-runoff processes, especially
29 the snow accumulation and melting process in cold regions, is important because the extent to
30 which the models accurately reproduce the reservoir inflows can significantly influence the
31 efficiency of the hydropower reservoir operation and subsequently the power price. Application
32 of hydrologic models for reproducing historic records can suffer from inadequacy in model

1 structure, incorrect model parameters, or erroneous data. Consequently, despite failing to
2 reproduce the observed hydrographs exactly, they enable simulation of hydrologic
3 characteristics of a study catchment to a fair degree of accuracy. It gets more challenging when
4 using the models in the operational setup for forecasting the unknown future just based on the
5 known past, which the model might not capture accurately. In the context of the Norwegian
6 hydropower systems, being unable to predict future reservoir inflows accurately has negative
7 consequences to the power producers. Norway's energy producers have to pledge the amount
8 of energy they produce for next 24 hours in the day-ahead market and if unable to provide the
9 pledged amount of energy the chance of incurring losses is very high. Estimation of future
10 reservoir inflows (be it long- or short-term) involves estimating the actual (initial) state of the
11 basin, forecasting the basin inputs during the lead-time, and describing the water movement
12 during the lead-time (Moll, 1983). Hence, the quality of a hydrologic forecast depends on the
13 accuracy achieved and methodology selected in implementing each of these aspects.

14 In this study, we intend to use conceptual and data-driven models complementarily. A
15 conceptual model with calibrated model parameters is used as the fundamental model that
16 approximately captures dominant hydrologic processes and forecasts behaviour of the
17 catchment deterministically. A data-driven model is then formulated on the residuals, the
18 difference between observations and predictions from the conceptual model. By studying the
19 whole set of residuals and exploring the information they contain, important information that
20 describes the inadequacies of the conceptual model can be extracted. In general, this kind of
21 information can be used for improving either the conceptual model itself or the prediction skill
22 of a forecasting system. Emulating the practice in most Norwegian hydropower reservoir
23 operators, we stick to the latter purpose with the aim of enhancing the performance of a
24 hydropower reservoir inflow forecasting system. According to Kachroo (1992), data-driven
25 models defined on the residuals from a conceptual model can expose whether the conceptual
26 model is adequate to identify essential relationships exhibited in the input-output data series.
27 Data-driven models can establish the mathematical relationship that describes the persistence
28 revealed in the residual time series, which is caused by failure of the conceptual model to
29 capture all the physical processes exactly. Thus, in the operational sense, the data driven models
30 can play a complementary role by adjusting output of the conceptual model whenever the
31 conceptual model needs corrective adaptation (e.g. Serban and Askew, 1991 and
32 World Meteorological Organization, 1992).

1 Several example applications can be found in the scientific literature on using conceptual and
2 data driven models complementarily. For instance, Toth et al. (1999) compared performance
3 improvements six ARIMA based error models brought to streamflow forecasts from a
4 conceptual model to identify the best error model and data requirements. Shamseldin and
5 O'Connor (2001) coupled a multi-layer neural network model on top of a conceptual rainfall-
6 runoff model to improve accuracy of stream flow forecasts without interfering with operation
7 of the conceptual model. Similarly, Madsen and Skotner (2005) developed a procedure for
8 improving operational flood forecasts by combining error models (linear and non-linear) and a
9 general filtering technique. Xiong and O'Connor (2002) investigated performance of four error-
10 forecast models namely, the single autoregressive, the autoregressive threshold, the fuzzy
11 autoregressive threshold and the artificial neural network updating models, for improving real-
12 time flow forecasts and compared their results. Likewise, Goswami et al. (2005) examined the
13 forecasting skill of eight error-modelling based updating methods. A recent review on the
14 application of error models and other data assimilation approaches for updating flow forecasts
15 from conceptual models can be found in Liu et al. (2012).

16 As reviewed above, the principle of complementing conceptual models with data-driven models
17 has enjoyed applications in real-time hydrologic forecasting since the 1990s. The
18 methodological contribution of the present work is reformulation of the parameter estimation
19 procedure for the data-based model. We recognize that the bias, persistence and
20 heteroscedasticity seen in the residuals from the conceptual model reflect structural inadequacy
21 of the conceptual model to capture the catchment processes and, hence, are important in
22 defining the manner the residual series is dealt with. Accordingly, we describe the reservoir
23 inflows in a transformed space and present an iterative algorithm for estimating parameters of
24 the data-driven model and the transformation parameters jointly.

25 Two main features distinguish application aspects of the present paper from previous published
26 works built on the same concept of complementing conceptual models with data driven models.
27 Firstly, it attempts to provide hourly reservoir inflows of improved accuracy 24 hours ahead.
28 The earlier papers mainly succeeded in improving forecasts for forecast lead-times up to six
29 time steps or incorporated a scheme to update the forecast system at an interval of six time-
30 steps. Secondly, an attempt is made in what follows, to produce a probabilistic forecast by
31 estimating the uncertainty of the error model, rather than only the deterministic estimate. This,
32 thereby, enables forecast of an ensemble of reservoir inflows, thereby allowing a risk-based

1 paradigm for hydropower generation being put to use. Reasons as to why hydrologic forecasts
2 should be probabilistic, and the potential benefits therein are presented and explained in
3 Krzysztofowicz (2001). Krzysztofowicz (1999) describes a methodology for probabilistic
4 forecasting via a deterministic hydrologic model. Li et al. (2013) provide review of scientific
5 papers that provide various regression and probabilistic approaches for assessing performance
6 of hydrologic models during calibration and uncertainty assessment. Smith et al. (2012)
7 demonstrate a good example of producing probabilistic forecasts based on deterministic
8 forecast outputs. In this paper, the improvement levels achieved are evaluated deterministically
9 using the same or similar metrics as past studies, and probabilistically using the containing ratio
10 (Xiong et al., 2009), which is also referred to as reliability score (e.g. Renard et al., 2010). We
11 here emphasise that taking into account uncertainties emanating from various recognized
12 sources and describing the degree of reliability of the inflow forecasts has important benefits.
13 According to Montanari and Brath (2004), the Bayesian forecasting system (BFS) and the
14 generalized likelihood uncertainty estimation (GLUE) are the popular methods for inferring the
15 uncertainty in hydrologic modelling. Yet, the scope of producing probabilistic inflow forecasts
16 in this study is limited to attaching a certain probability to the deterministic forecasts so
17 common in the Norwegian hydropower industry based on analysis of the statistical properties
18 of the error series from the conceptual model, and assessing its degree of reliability.

19 In the next section, the complementary model setup is formulated and the performance
20 evaluation criteria are provided. An example application is presented in the subsequent section.
21 This includes description of the study area and data used, findings from the evaluation of the
22 complimentary setup and its components during calibration and validation, and results of
23 forecasting skill assessment using deterministic and reliability metrics. Finally, concluding
24 remarks are provided.

25 **2 Methodology**

26 **2.1 The conceptual model setup**

27 The widely applied conceptual hydrologic model—HBV—(Bergström, 1995) is used in this
28 study. The version used allows dividing the study catchment up to 10 elevation zones. A
29 deterministic HBV model with already calibrated model parameter values was assumed to take
30 the role of the operational hydrologic models Norwegian hydropower companies commonly
31 use for forecasting reservoir inflows. In the operational setup, the air temperature and

1 precipitation input over the forecast lead-time are obtained from the Norwegian Meteorological
 2 Institute (www.met.no). As this study aims to improve hydrologic forecasts into the
 3 hydropower reservoirs by complementing the conceptual model by an error model, we assume
 4 that the predictions from the HBV model are made using as good quality input data as possible.
 5 Hence, the observed air temperature and precipitation data are used as input forecasts in
 6 hindcast.

7 2.2 The complementary error model

8 The error model aims at exploiting the bias, persistence and heteroscedasticity in the residuals
 9 and estimating the errors likely to occur in the forecast lead-time. Forecasting the error in the
 10 lead-time is regarded as a two-step process: off-line identification and estimation of the error
 11 model, and error predictions based on most recent information.

12 2.2.1 Identification of the model structure

13 An error model that captures the structures the processes model is missing should lead to a zero-
 14 mean-homoscedastic residual series from the modelling framework. In order to identify the
 15 right structure and establish a parsimonious model that adequately describes the data, we
 16 diagnose the residuals and address the bias, persistence and heteroscedasticity the series might
 17 exhibit as follows.

18 First and foremost, we transform the observed (Q) and the predicted (\hat{q} , from the conceptual
 19 model) inflows into z and \hat{z} , respectively. This way we deal with the heteroscedasticity seen
 20 in the residuals by making repeated use of Eq. 1 with the appropriate inflow term.

$$21 \hat{z}_t = \begin{cases} \left((\hat{q}_t + \beta)^\lambda - \beta \right) \lambda^{-1} & \lambda > 0 \\ \log(\hat{q}_t + \beta) & \lambda = 0 \end{cases} \quad (1)$$

22 where β and λ are the transformation parameters.

23 The discrepancy (ε) between the observed and predicted inflow at time step (t) can be
 24 expressed as $\varepsilon_t = z_t - \hat{z}_t$. Analysis of whether the residuals are random or show some bias
 25 follows. Lest the mean of the residuals would be different from zero, the mean error (μ_e) is
 26 subtracted from the error series (ε) to produce a zero-mean residual series ($e_t = \varepsilon_t - \mu_e$). This
 27 is followed by assessment of the auto correlation function (acf) and partial autocorrelation

1 function (pacf), which are keys for identifying the order of Markovian dependence the residuals
 2 exhibit. We consider an autoregressive (AR) model structure (Eq. 2) to represent the persistence
 3 structure in the residual series. Comparative assessment of error models of different complexity
 4 would be an interesting work but is beyond the scope of this study. Xiong and O'Connor (2002)
 5 affirm that AR model's longstanding popularity is deservedly right and further emphasize
 6 effectiveness of a very parsimonious model such as AR model for error forecasting.

$$7 \quad \hat{e}_t = \sum_i^p a_i e_{t-i} \quad (2)$$

8 where p designates the length of the lag-time, and a_1, a_2, \dots, a_p are coefficients of the AR
 9 model.

10 In order to provide improved hourly reservoir inflow forecasts over a 24 hours lead-time, the
 11 error-forecasting model takes the form of Eq. (3). In order to overcome lack of observed
 12 residuals encountered for forecast lead-time (f) longer than one-step ahead, it is necessary to
 13 utilize estimated errors as inputs (see Eq. 3). The number of estimated errors values to be used
 14 as inputs depends on the identified order of the AR model and can vary across the forecast lead-
 15 times.

$$16 \quad \hat{e}_{t+f} = \begin{cases} \sum_{i=1}^p a_i e_{t+f-i} & \text{for } f = 1 \\ \sum_{i=1}^{f-1} a_i \hat{e}_{t+f-i} + \sum_{i=f}^p a_i e_{t+f-i} & \text{for } f \geq 2 \text{ and } p \geq f \\ \sum_{i=1}^p a_i \hat{e}_{t+f-i} & \text{for } f \geq 2 \text{ and } p < f \end{cases} \quad (3)$$

17 In its complete form, the error-corrected reservoir inflow forecast (z') from the complementary
 18 modelling framework can be given as

$$19 \quad z'_{t+f} = \hat{z}_{t+f} + (\mu_e + \hat{e}_{t+f}) \quad (4)$$

20 **2.2.2 Parameter Estimation**

21 Parameters of the AR model can be set to the corresponding Yule-Walker estimates of
 22 a_1, a_2, \dots, a_p given the autocorrelation function of the error series fulfils a form of linear
 23 difference equation. However, in practice, Eq. (2) can be treated as a linear regression and

1 parameters can be estimated by Least Squares method as demonstrated by Xiong and O'Connor
 2 (2002). An iterative algorithm suggested in Beven et al. (2008) is adopted for estimating the
 3 model parameters while optimizing transformation of the inflow data. Adoption of a
 4 methodology that amalgamates parameter estimation and Box-Cox (Box and Cox, 1964)
 5 inspired transformation of inflow is useful for taking into account the heteroscedastic residuals
 6 and obtaining a normally distributed residual series from the error model. The parameter and
 7 inflow transformation steps with a little modification from Beven et al. (2008) over the
 8 calibration period $(1, \dots, T)$ are as follows:

- 9 1. Select values of $\beta, \lambda > 0$ and transform the reservoir inflows $(\hat{q}_{1:T}, Q_{1:T})$ to get
 10 $(\hat{z}_{1:T}, z_{1:T})$ using Eq. 1.
- 11 2. Calculate the residuals series from the transformed inflow data $(\varepsilon_{1:T} = z_{1:T} - \hat{z}_{1:T})$.
- 12 3. Perform an optimization for the error model parameters (a_1, a_2, \dots, a_p) to minimize
 13 $\sum (\varepsilon_{1:T} - \hat{\varepsilon}_{1:T})^2$, where $\hat{\varepsilon}$ represents the forecast from the error model which at a
 14 given observation time step (t) equals $(\mu_e + \hat{e}_t)$. Thus, the observed (ε) and
 15 forecasted $(\hat{\varepsilon})$ errors at a given observation time step (t) can be related as
 16 $\varepsilon_t = \hat{\varepsilon}_t + \eta_t$, where η_t is a random noise that describes the total uncertainty
 17 originating from various sources.
- 18 4. Adjust (β, λ) and repeat the optimization until the residuals of the error model
 19 appear homoscedastic. The η_t term (step 3) is assumed to be unimodal, symmetric
 20 and unbounded random variable with a zero expected-mean and second moment
 21 given as σ^2 .

22 2.3 Performance evaluation

23 In addition to visual evaluation of the hydrographs, performance of the present procedure is
 24 robustly analysed using deterministic and reliability metrics. The root mean square error
 25 (RMSE), relative error (RE) and the Nash-Sutcliffe efficiency (NSE) (Nash and Sutcliffe,
 26 1970) are employed to evaluate efficiency of the models during calibration and validation
 27 deterministically. Evaluations are made with respect to varying forecast lead-times and season
 28 wise as well. Among the three statistical performance criteria, the RE (Eq. 5) measures the

1 relative error between the total observed and predicted inflow volume. For a good simulation the
2 value of RE is expected to be close to zero. Quantifying the relative error (RE) of the
3 simulations/forecasts is important because it indicates how the inaccuracies affect a hydropower
4 company's ability to deliver the amount of energy it has pledged to provide to the energy
5 market. Therefore, special attention is given to the less aggregate version of RE , which we
6 hereon refer to as percentage volume error (PVE) and describe as follows.

$$7 \quad RE = \frac{\sum (z_t - \hat{z}_t)}{\sum z_t} \times 100\% \quad (5)$$

8 The PVE designates the relative error at each time step, which in reference to Eq. 5 can be
9 obtained by omitting aggregation of the errors by summation. It indicates the magnitude of the
10 errors as percentage of the observed inflows at each inflow time step. From hydropower systems
11 operations point of view, the PVE enables evaluation of the forecast errors at each time step
12 and assess implication on the power production capacity directly. The PVE analysis devised
13 here divides the computed PVE s into six PVE classes (i.e. $\leq 10\%$, 10-20%, 20-30%, 30-40%,
14 40-50% and $>50\%$), and treats overestimates and underestimates separately. The number of
15 times each of the six absolute PVE classes appeared in the set or subset of interest (i.e.
16 hydrologic year or seasons) is constructed by keeping score of the PVE class into which each
17 and every residual fell in. Then the fraction of time each PVE class occurred is divided to the
18 total number of points in the given set/subset and is reported as a percentage. This is designated
19 as a “ PVE count”. Model performance assessment using PVE (during simulation and
20 forecasting) mainly focuses on assessing the change in number the number of incidences in
21 each PVE set, which in other words means the change in PVE counts. The PVE count/change
22 in PVE count, along with the above-mentioned deterministic statistical criteria, is used for
23 evaluating simulation and forecasting skill of the complementarily setup system (conceptual
24 model + error model). As a metric for measuring relative improvement in forecasting skills,
25 high PVE counts for the low PVE classes (e.g. $\leq 10\%$) is considered desirable quality. The
26 justification is that, the penalty a power producer incurs when failing to deliver the pledged
27 amount of power would be lesser if its forecasting system makes errors of lower PVE classes
28 more frequently.

29 Another useful metric used for assessing forecasting skill of the complementary setup is through
30 uncertainty analysis. An interval forecast (Chatfield, 2000) can be constructed by specifying an
31 upper and lower limit between which the future reservoir inflow is expected to lie with a certain

1 probability ($1-\alpha$). The prediction interval for the inflow forecast are estimated using the
2 Linear Regression Variance Estimator (LRVE) Shrestha and Solomatine (2006) describe.
3 Xiong et al. (2009) outline several indices that can serve for describing the properties of
4 prediction bounds of particular probability and for comparative study of prediction intervals
5 resulting from different uncertainty assessment schemes. The indices characterise the prediction
6 bound either by: the percentage of observations it contains, its band-width, or its symmetry
7 relative to the observation. According to Xiong et al. (2009), of all indices the containing ratio
8 (*CR*), which describes the percentage of observed inflows falling in the desired interval
9 percentage, is the widely used metrics for assessing reliability of probabilistic forecasts. We
10 adopt the *CR* for describing the reliability of the forecasts with the desired interval percentage
11 of 95% ($\alpha = 0.05$).

12

13 **3 Example application**

14 **3.1 Study area and data**

15 The Krinsvatn catchment is located in Nord Trøndelag County in mid-north Norway. It
16 comprises an area of 207 km² and about 57% of the catchment is mountain area above
17 timberline. The elevation ranges from 87 to 628 m above mean sea level and is drained by the
18 Stjørna/Nord River. The dominant land use is forest covering 20.2% of the study site while
19 marsh, lakes and farmlands cover about 9%, 6.7% and 0.4% of the catchment area, respectively.
20 Figure 1 provides location and main characteristics of the study site, and the daily potential
21 evapotranspiration values used.

22 Observed hourly data of eleven water-years (2000/01 to 2010/11) was split into three sets used
23 for warming-up (2000/01), calibrating (2001/02-2005/06) and validating (2006/07-2010/11)
24 the conceptual and the error models alike. Observed precipitation and temperature data of two
25 meteorological stations (i.e. Svar-Sliper and Mørre-Breivoll) in neighbouring catchments are
26 used. Discharge data for the catchment is derived from water level records at the Krinsvatn
27 gauge station. Beven (2001) outlines the advantages to direct use of water level information in
28 hydrologic forecasting. Rating curve uncertainties and their influence on the accuracy of flood
29 predictions have been documented very well (e.g. Sikorska et al. 2013; Aronica et al., 2006;
30 Pappenberger et al. 2006; Petersen-Overleir et al. 2009). Krinsvatn is considered a stable
31 discharge measurement site with few external influences, and the rating curve was updated in

1 2004. This study, however, considers the uncertainty of the rating-curve to be one of the factors
2 contributing to the total error expressed in Eq. 2 and does not address it separately.

3 **3.2 HBV model for Krinsvatn catchment**

4 The catchment is divided into 10 elevation zones in the HBV model setup. Input data used are
5 hourly areal precipitation, air temperature, and potential evapotranspiration. The model is run
6 on an hourly time step for water years 2000/01 to 2005/06 with the last five water years being
7 used for model calibration. Calibration is carried out using the shuffled complex evolution
8 algorithm (Duan et al., 1993), with the NSE between the observed and predicted flows as an
9 objective function. Description of the model parameters along the corresponding optimized
10 values is provided in Table1.

11 **3.2.1 Overview of the conceptual model's performance**

12 The simulation and observed reservoir inflow hydrographs shown in Fig. 2 indicate a certain
13 level of agreement for most of the calibration and validation periods, which the statistical
14 evaluations (Table 2) agree with. The overall hourly reservoir inflow predictions during
15 calibration and validation show efficiency of $NSE > 0.5$ and $RE < \pm 25\%$; even though
16 simulations match observations better during calibration than validation. High NSE values ($>$
17 0.8) during both calibration and validation reveal that the inflow simulations fit the observed
18 hydrographs best in the winter seasons. Nevertheless, it is evident that model predictions in the
19 validation period are prone to underestimation bias ($RE > 0$). Season wise assessment of the
20 validation period reveals the conceptual model's tendency to underestimate reservoir inflows
21 in spring and summer considerably. In light of what the NSE and PBIS metrics suggest, the
22 lower RMSE values (i.e. for instance summer season) do not reflect superior model
23 performances.

24 PVE counts of the six PVE classes (i.e. $\leq 10\%$, $10-20\%$, $20-30\%$, $30-40\%$, $40-50\%$ and $>50\%$)
25 are computed on the residuals between observed and simulated reservoir inflows. The stacked-
26 columns of Fig. 3a&b show how frequently each of the six absolute PVE classes occurred over
27 the calibration and validation period. The results reveal a large degree of discrepancy between
28 observations and predictions during calibration and validation. Simulated inflows deviated from
29 the corresponding observed values by a magnitude of more than $\pm 10\%$ in about 83.3%
30 (calibration) and 88.6% (validation) of the respective simulation time steps. Huge difference
31 between observations and simulations is noted in the summer season with absolute PVE of the

1 class $>50\%$ occurring in more than half of the simulation time steps throughout the calibration
2 and validation periods. Winter simulations listed the highest level of occurrence of PVE of the
3 class $\leq\pm 10\%$ during both calibration and validation. Comparable to the results in Table 2,
4 volume errors in winter simulations do not seem to be a serious problem, probably because the
5 season is predominantly a snow accumulation rather than runoff generation period. Errors of
6 the high absolute PVE classes scored high PVE counts in the spring and autumn seasons.

7 Details of the extent to which the reservoir inflows are under- and over-estimated can be seen
8 in Fig. 3c&d. The fraction of time the simulated inflows exhibited under- and over-estimation
9 during calibration is 51.9% and 46.8%, respectively. In the validation period, the reservoir
10 inflows are underestimated about 65.6% of the time compared to overestimation in 33.4% of
11 the times. This is also revealed in the findings from statistical metrics in Table 2, which disclose
12 the bias in the model. Yet, the results in Fig. 3 further reveal that the model predictions deviate
13 from the observations at high discharges. For example, during the validation period 59.2% of
14 the times observations exceeded the predictions by magnitudes more than 10%. Such
15 information is useful because direct evaluation of observed and predicted values explains the
16 implications of model performance on the planning and operation of a hydropower system
17 better than an aggregated variance based statistic. From an operational management point of
18 view, considerable underestimation of reservoir inflows can have both short- and long-term
19 effects on the operation of a hydropower system. In the short-term, the company could be forced
20 to release unvalued water especially when the reservoir water level is close to its maximum
21 capacity. Hence, the high percentage of underestimations that occur in the autumn and spring
22 seasons (during calibration and validation) should not be tolerated because the inflows in the
23 autumn and spring seasons are very important. On the one hand, substantial overestimation of
24 reservoir inflows can at least expose any Norwegian hydropower company to undesirable
25 expense due to obligations to match the power supply it has failed to deliver by dealing with
26 other producers in the intra-day physical market (Elbas). Although overestimation does not
27 seem to be a pertinent issue, Fig. 3d un.masks that the inflows are overestimated by a magnitude
28 $>50\%$ at least 10% of the time in all seasons.

29 **3.2.2 Residual analysis**

30 Following the example of Xu (2001), a Kolmogorov-Smirnov test is applied to residuals of the
31 conceptual model. The test revealed that the residuals are not normally distributed. The

1 maximum deviation between the theoretical and the sample lines is 0.130, which is larger than
2 Kolmogorov-Smirnov test statistic of 0.008 at significance level $\alpha = 0.05$.

3 Presence of homoscedasticity in the residuals series is diagnosed visually by plotting the
4 residuals versus the predicted reservoir inflows (Fig. 4a). With respect to the horizontal axis,
5 the scattergram does not remain symmetric for the entire range of predicted inflows. The
6 residuals show high variability and possible systematic bias when inflows are less than 3.5mm
7 while the opposite is true when the inflows exceed 3.5mm. Inflows of magnitudes between 3.5
8 and 5.5mm seem to be underestimated while overestimation is visible when the inflow rates are
9 greater than 5.5mm. However, as can be seen from Fig. 2, inflows of magnitude up to 3mm
10 represent reservoir inflows during the rise of the hydrographs including all peak inflows for all
11 hydrologic years but 2005/2006 and 2010/2011. Hence, except for the possible systematic bias
12 during low flows, the inference from the scatterplot is inconclusive to support or dismiss the
13 issue of predominant underestimation revealed in the model performance evaluation. Moreover,
14 hourly inflows of magnitudes higher than 3mm are rare and occurred about 0.1% of the times
15 over the calibration and validation period.

16 Plots of autocorrelation and partial autocorrelation functions of the residual time series (Fig.
17 4b&c) indicate a strong time persistence structure in the error series. Rapid decaying of the
18 partial autocorrelation function confirms the dominance of an autoregressive process, which
19 the gradually decaying pattern of the autocorrelation function also suggests. Thus, in order to
20 obtain a Gaussian series it is important to address issues of heteroscedasticity and serial
21 correlation in the residual series. As the current study aims at utilising the persistent structure
22 in the residuals for supplementing the forecasting system, the corrective action to be taken only
23 aims at removing the heteroscedasticity. A successful way to do it is through transformation of
24 the flow data (e.g. Engeland et al., 2005). As outlined in the methodology section, the reservoir
25 inflows (both observed and predicted) are transformed while estimating parameters of the error
26 model.

27 **3.3 Structure and performance of the error model**

28 In accordance with the findings from the ACF and PACF plots discussed in section 3.3.2, AR
29 models of up to order $p = 3$ were investigated while estimating parameters of the error model.
30 As outlined in section 2.2.2, coefficient of the AR(p) model and the transformation parameters
31 were estimated by minimizing the sum of the squares of the offsets between the inflows

1 (observed and predicted) in the transformed space, and assessment of whether the subsequent
2 residuals from the complementary modelling framework appear homoscedastic and exhibited
3 correlation. The latter was assessed using the Kolmogorov-Smirnov (KS) statistic as a relative
4 quantitative measure followed by visual inspection of the residual plots, which led to the
5 selection of an AR(1) model with transformation parameters $\beta = 41.4$ and $\lambda = 0.9$, bias
6 correction $\mu_e = 0.021$ and coefficient $a_1 = 0.97$.

7 Calibration efficiencies calculated for the error model using the RMSE, RE and NSE metrics
8 are 0.096, -100% and 0.517, respectively. Corresponding values for the validation period are
9 computed as 0.095, 20.3% and 0.630, respectively. NSE values for the calibration and
10 validation periods imply ability of the error model to capture at least half of the discrepancies
11 observed between observations and predictions from the conceptual model. The transformation
12 reduced the maximum deviation between the theoretical and the sample lines slightly from 0.13
13 to 0.10, yet the residuals are not normally distributed (i.e. Kolmogorov-Smirnov statistic of 0.008
14 at significance level of $\alpha = 0.05$). This implies that the assumption the residuals from the
15 complementary forecasting system would be Gaussian is far from being true. As the aim of this
16 study is to utilize the error and complementary models additively, the extent to which the
17 complementary setup boosted prediction ability in the forecasting mode is discussed in the next
18 section.

19 **3.4 Forecasting skill of the complementary setup (deterministic assessment)**

20 Imitating operational application of forecasting models in the Norwegian hydropower system,
21 reservoir inflows for the day-ahead market (Elspot) are estimated using the presented
22 forecasting system. The system has to run once a day at an hourly time step, sometime before
23 12 pm after retrieving the latest observations, and the inflow forecasts are issued for the next
24 24 hourly time steps beginning from 12 o'clock noon. Overall performance of the
25 complementary model in forecasting the reservoir inflows during the calibration and validation
26 periods is first discussed and is followed by evaluation of its forecasting skill with respect to
27 forecast lead-times. Evaluation of the forecast skill presented in this paper is based on
28 assessment of forecasts made for the period between 2006/07 and 2010/11 as the datasets from
29 2000/01 to 2005/06 are used for calibrating the system.

1 **3.4.1 Overall performance**

2 Assessment of the overall forecasting skill of the complementary setup shows significant
3 improvement in forecast accuracy. The RMSE and NSE statistical criteria computed between
4 forecasted and observed inflows are 0.095 and 0.896, respectively. RMSE values for the
5 autumn, winter, spring and summer forecasts are 0.094, 0.090, 0.132 and 0.044, respectively,
6 and the corresponding NSE values are 0.904, 0.905, 0.859 and 0.873.

7 Proving capability of the complementary setup to reduce the bias revealed in the simulation
8 forecasts from the conceptual model, which was pointed out in the previous section, the 24
9 hours lead-time forecasts exhibited low-level underestimation bias with RE equal to 3.8%.
10 Degree of bias in the inflow forecasts differed seasonally. RE computed for each season in a
11 decreasing order is, summer (-10.2%), spring (4.6%), autumn (2.9%) and winter (0.7%). The
12 relatively higher bias in the spring and autumn forecasts can be related to runoff generation in
13 the Krinsvatn catchment due to snow melting or occurrence of precipitation in the form of
14 rainfall, which can affect the persistence structure in the residual series obtained from the
15 conceptual model.

16 Stacked-column plots in Fig. 5 display the occurrence level of each of the six PVE classes in
17 the residual series between forecasts and observations. Visual comparison of stacked-column
18 plots of Fig. 5 and Fig. 3 shows reduction in PVE count of the high PVE classes and increase
19 in PVE counts of low PVE classes; e.g., PVE count for the PVE class $> \pm 50\%$ decreased by
20 about 15% while PVE count for the PVE class $\leq \pm 10\%$ grew by about 50%. In order to assess
21 this assertion, a further assessment is carried out by dividing the six PVE classes into two
22 groups: low PVE ($\text{PVE} \leq \pm 10\%$) and high PVE ($\text{PVE} > \pm 10\%$). Ratio between seasonal PVE
23 counts of the low and high PVE classes is taken and comparison is made on two sets of residual
24 series. These sets of residuals are, (1) residuals from the simulated forecasts (conceptual model),
25 and (2) residuals from forecasts of the complementary setup. Results are presented in Table 3.
26 Apart from confirming the success in reducing PVE counts of high PVE errors, the results
27 indicate that equal level of success is not achieved in all four seasons. In relative terms, high
28 PVE errors occur more often in the spring and summer forecasts. As pointed out earlier, this
29 can be associated to the snowmelt and, to a certain degree, to rainfall incidents occurring in
30 these seasons.

3.4.2 Forecast skill with respect to forecast-lead times

Relative reductions in RMSE between forecasts from the complementary setup and the simulated forecasts from the conceptual model are computed. Detailed results for each season of the hydrologic years between 2006/07 and 2010/11 are presented in Table 4. The results are also summarized in terms of the minimum, mean and maximum relative RMSE reduction as shown in Fig. 6. Excluding forecasts in autumn and winter seasons of 2006/07, relative RMSE reductions are observed in forecasts of short and long lead-times. Of course, in all four seasons, the achieved level of improvement in forecast accuracy is high for short lead-times and diminishes gradually with increased lead-time. Results show that accuracy of the reservoir inflows in the spring and summer seasons are improved over the entire range of the forecast lead-time. Likewise, reduction in RMSE is observed for all autumn and winter inflow forecasts except for years 2006/07 and 2007/08, respectively.

In order to get insight on the improvement level in a unit directly related to hydropower production, the change in PVE count of each PVE class is calculated. Change in PVE count of a given absolute PVE classes is the difference between the PVE counts for the complementary setup and that for the conceptual model. The results are summarized as shown in Fig. 7. The figure shows that the PVE count of high magnitude absolute PVE classes are reduced and the opposite is true for that of the smaller absolute PVE classes. For instance, regardless of the type of discrepancy (under- or over-estimation) noted, the change in PVE counts of the absolute PVE of the class $>50\%$ is negative. The negative sign implies less errors falling in this PVE class in the residual series from the complementary setup than those from the conceptual model. Similarly, the changes in PVE counts of the 20-30%, 30-40% and 40-50% absolute PVE classes indicate lowered fraction of occurrence of errors of these orders. In both cases of under- and over-estimation, absolute PVE of the class $\leq 10\%$ occurred more frequently; for example, the fraction of time reservoir inflow forecasts of 1 hour lead-time deviated from the observations by a magnitude $\leq 10\%$ increased by about 52.7 and 27.7% during under- and over-estimations. Overall, the plots show that the magnitude of discrepancy at each forecasting point is significantly reduced. The improvement level at each forecast lead-time is proportional to the vertical distance from the horizontal axis. It can be noted that, the vertical distance narrows down with increasing lead-time suggesting a declining improvement level with increased lead-time.

1 Calculation of the relative RMSE reduction and the change in PVE counts agree that the
2 forecast accuracy is improved through the complementary setup. The assessments further
3 revealed that the degree of improvement weakens with increased forecast lead-time. However,
4 the relative RMSE reduction computations indicate that in some occasions the simulated inflow
5 forecasts stand out to be better. The relative RMSE reduction values for lead-times longer than
6 20 hours (Table 4) show that complementing the conceptual model with an error model is
7 counterproductive in autumn and winter seasons of years 2007/08 and 2006/07, respectively.

8 **3.5 Reliability of the inflow forecast**

9 Computation of the containing ratio (*CR*) for the entire forecast reveals that 96% of the
10 observations are inside the 95% prediction interval. The inflow hydrographs (Fig. 8) confirm
11 that most of the observed inflows are contained in the specified uncertainty bounds.

12 The percentage of observation points falling within the 95% prediction interval varies from
13 season to season and across hydrologic years (see Fig. 9a). All observed winter and summer
14 inflows are bracketed in the 95% uncertainty bound at least 95% of the time. In general, the
15 winter season is more of a snow accumulation period and a closer observation of the
16 hydrographs (see Fig. 8) reveals that the summer hydrographs cover the recession and base flow
17 portions of the annual hydrographs. Thus, better persistence structure and predictable
18 discrepancies between simulated forecasts from the conceptual model and the observations. As
19 Goswami et al. (2005) argue, the persistence structure in residual series primarily arises from
20 the dynamic storage effects of a catchment system.

21 The desired percentage of autumn observations is contained in the 95% prediction interval in
22 the years 2006/07, 2008/09 and 2010/11. In the years 2007/08 and 2009/10, however, only 93
23 and 94% of the observed autumn inflows are bracketed in the estimated 95% prediction
24 intervals, respectively. Reliability score (*CR*) calculations for the spring season indicate that
25 percentage of observation points falling in the desired prediction interval percentage are below
26 95% except in the hydrologic years 2007/08 and 2008/09. Unlike winter and summer inflows,
27 autumn and spring flows mostly cover portions of the hydrograph corresponding to the rising
28 limb or high flow regime (see Fig. 8). While physical factors contributing to the increase in
29 quick flow into the reservoir are precipitation incidents (in the form of rainfall) and melting of
30 snow in the headwaters, comprehension of this concept and its encapsulation into the HBV
31 model leaves control of the catchment response to two threshold values (TX and TS, see Table

1 1 for description). Employing such simple threshold values to govern initiation of the runoff
2 generation process based on air temperature measurement at a given time-step obviously
3 involves more sources of uncertainty (i.e. measurement, model structure and model
4 parameters). For instance, we assume the input air temperature at a given time step is
5 erroneously recorded to be higher than TX and/or TS due to measurement error. Subsequently,
6 the model will partition the precipitation as rainfall and initiate melting of snow, which the
7 observation does not reveal. This kind of misclassification of precipitation and/or
8 misrepresentation of snow accumulation and melting processes can simply occur due to the
9 error in the input temperature record. Because of this, the persistence in the errors between
10 simulated forecasts from the conceptual model and the observations can get weaker. According
11 to Goswami et al. (2005), some degree of persistence in the model input (i.e. rainfall) is another
12 primary source of the persistence characteristic of observed flow series. Even though the least
13 *CR* calculated for the autumn and spring seasons are by no means too bad (i.e. 93% and 90%,
14 respectively), the requirement for reliability is for the uncertainty bound to contain as much
15 fraction of observations as desired percentage of prediction interval; hence, the complementary
16 setup presented seems to have struggled with it.

17 The fraction of observed inflows bounded within the estimated prediction interval decreases
18 with increased lead-time (Fig. 9b). Reliability score for lead-times up to 17 hours fulfil the
19 requirement of containing 95% of the observations. For lead-times beyond 17 hours, the
20 reliability declines and reaches 92% at forecasts lead-time of 24 hours.

21 Findings from evaluation of the forecast skill of the complementary setup using deterministic
22 and probabilistic metrics support each other. The present procedure is able to improve accuracy
23 of reservoir inflow forecasts and the level of improvement decreases as the forecast lead-time
24 increases. Deterministic evaluation of performance of the forecast system indicates that the
25 concept of complementing the conceptual model with a simple error is not always effective. As
26 discussed earlier, in some occasions the present method can get counterproductive in
27 forecasting inflows when the forecast lead-time is beyond 20 hours. Similarly, detailed
28 assessment of the reliability (Table 5) shows that the *CR* of the forecasting system can get below
29 95% at forecast lead-times less than 17 hours; e.g. at forecast lead-time of 9 hours only 89% of
30 the observed spring inflows of year 2006/07 are bracketed in the 95% prediction interval.

31

1 **4 Concluding remarks**

2 In the present study, the forecasting system comprising additively setup conceptual and simple
3 error model is presented. Parameters of the conceptual model were left unaltered, as are in most
4 operational setups, and the data-driven model was arranged to forecast the corrective measures
5 to be made to outputs of the conceptual models to provide more accurate inflow forecasts into
6 hydropower reservoirs several hours ahead.

7 Application to the Krinsvatn catchment revealed that the present procedure could effectively
8 improve forecast accuracy over a 24 hours lead-time. This proves that the efficiency of a flow
9 forecasting system can be enhanced by setting up a data-driven model to complement a
10 conceptual model operating in the simulation mode. Furthermore, the current study reveals that
11 analysing characteristics of the residuals from the conceptual model is important and
12 heteroscedastic behaviour should be addressed before identifying and estimating parameters of
13 the error model. Compared to past studies that applied data-driven and conceptual models in a
14 complementary way, the present procedure is successful in providing acceptably accurate
15 forecast for extended lead-times. It also outlines procedure for extracting useful information
16 from the bias, the persistence and the heteroscedasticity the residual series from the conceptual
17 model exhibited, although the assumption that the residuals from the modelling framework to
18 be random failed to hold.

19 Results also indicate that probabilistic forecasts can be obtained from deterministic models by
20 constructing uncertainty of the complementary setup based on predictive uncertainty of the
21 simple error model. The uncertainty bound seems to satisfy the reliability requirement when
22 evaluated over the entire forecasting period. Its reliability with respect to forecast lead-time also
23 appears satisfactory for lead-times up to 17 hours. Nevertheless, the season wise assessment
24 revealed that the degree of reliability of the forecasts vary from season to season. Given that
25 the error model essentially makes use of the persistence structure in the residuals from the
26 conceptual model, the present procedure seems to be unable to capture transitions in the
27 hydrograph errors from over- to under-estimation (and vice versa). On the one hand, it was
28 unveiled that the degree of reliability of the forecasts decline with longer lead-times and the
29 deterministic metrics (RMSE and PVE) confirmed the same.

30 In order to address these challenges, a future development can be to explore methodologies for
31 taking care of seasonal variability in the structure of the residual series. Updating the error
32 models periodically can be one solution but care must be taken if the selected updating method

1 makes a Gaussian assumption. Another alternative would be to explore more complex
2 stochastic models for the residuals, that use exogenous predictor variables either observed
3 directly (much like the seasonal reservoir inflow forecasting models described in Sharma et al,
4 2000), or using state variables simulated from the conceptual model (like the Hierarchical
5 Mixtures of Experts framework in Marshall et al, 2006 and Jeremiah et al, 2013). Formulation
6 of these models will also offer better insight into the deficiencies that exist within the HBV
7 conceptual model, thereby allowing further improvement to reduce the structural errors present.

8 Another interesting topic of future investigation is the intercomparison of the probabilistic
9 forecasts presented in the current paper with the same from popular methods such as Bayesian
10 forecasting system (BFS), the generalized likelihood uncertainty estimation (GLUE) and the
11 Bayesian recursive estimation (BaRE). We believe this would enable identification of the most
12 effective and reliable probabilistic forecasting method that can also be implemented in an
13 operational setup.

14

15 **Acknowledgements**

16 This work was supported by the Norwegian Research Council through the project Updating
17 Methodology in Operational Runoff Models (192958/S60) and the consortium of Norwegian
18 hydropower companies led by Statkraft. The hydrological data used in the project were
19 retrieved from database of the Norwegian Water Resources and Energy Directorate (NVE). The
20 meteorological data were obtained from Trønderenergi AS and we thank Elena Akhtari for
21 making them available to us. We would like to acknowledge the assistance of Professor Keith
22 Beven in the preparation of this manuscript.

23

1 **References**

- 2 Abebe, A. J. and Price, R. K.: Managing uncertainty in hydrological models using
3 complementary models, *Hydrolog. Sci. J.*, 48(5), 679-692, 2003.
- 4 Aronica, G. T., Candela, A., Viola, F., and Cannarozz, M.: Influence of rating curve uncertainty
5 on daily rainfall - runoff model predictions, *Predictions in Ungauged Basins: Promise and*
6 *Progress*, 303, 116-124, 2006.
- 7 Bergström, S.: The HBV model, in: *Computer Models of Watershed Hydrology*, edited by:
8 Singh, V.P., Water Resources Publications, Highlands Ranch, CO., 443-476, 1995.
- 9 Beven, K.: *Environmental Modelling: An Uncertain Future?*, Taylor and Francis Group,
10 London and New York, 2009.
- 11 Beven, K.: *Rainfall-runoff modelling: The primer*, 2nd ed., Wiley-Blackwell, Chichester, 2012.
- 12 Beven, K. J., Smith, P.J., and Freer, J.: So just why would a modeller choose to be incoherent?,
13 *J. Hydrol.*, 354, 15-32, 2008.
- 14 Box, G.E.P. and Cox, D.R.: An analysis of transformations. *J. Roy. Stat. Soc. B Met.*, 211-252,
15 1964.
- 16 Chatfield, C.: *Time-series forecasting*, CRC Press, 2000.
- 17 Engeland, K., Xu, C.-Y., and Gottschalk, L.: Assessing uncertainties in a conceptual water
18 balance model using Bayesian methodology, *Hydrolog. Sci. J.*, 50(1), 45-63, 2005.
- 19 Goswami, M., O'Connor, K. M., Bhattarai, K. P., and Shamseldin, A. Y.: Assessing the
20 performance of eight real-time updating models and procedures for the Brosna River, *Hydrol.*
21 *Earth Syst. Sc.*, 9(4), 394-411, 2005.
- 22 Jeremiah, E., Marshall, L., Sisson, S. A., and Sharma, A.: Specifying a hierarchical mixture of
23 experts for hydrologic modeling: Gating function variable selection, *Water Resour. Res.*, 49(5),
24 2926-2939, 2013.
- 25 Kachroo, R. K.: River flow forecasting: Part 1 - A discussion of the principles, *J. Hydrol.*, Vol.
26 133, 1-15, 1992.
- 27 Krzysztofowicz, R.: Bayesian theory of probabilistic forecasting via deterministic hydrologic
28 model, *Water Resour. Res.*, 35(9), 2739-2750, 1999.

1 Krzysztofowicz, R.: The case for probabilistic forecasting in hydrology, *J. Hydrol.*, 249(1–4),
2 2-9, 2001.

3 Li, L., Xu, C. Y., and Engeland, K.: Development and comparison in uncertainty assessment
4 based Bayesian modularization method in hydrological modeling. *J. Hydrol.*, 486, 384-394,
5 2013.

6 Liu, Y., Weerts, A. H., Clark, M., Hendricks Franssen, H.-J., Kumar, S., Moradkhani, H., Seo,
7 D.-J., Schwanenberg, D., Smith, P., van Dijk, A. I. J. M., van Velzen, N., He, M., Lee, H., Noh,
8 S. J., Rakovec, O., and Restrepo, P.: Advancing data assimilation in operational hydrologic
9 forecasting: progresses, challenges, and emerging opportunities, *Hydrol. Earth Syst. Sci.*, 16,
10 3863–3887, doi:10.5194/hess-16-3863-2012, 2012.

11 Madsen, H. and Skotner, C.: Adaptive state updating in real-time flow forecasting—a combined
12 filtering and error forecasting procedure, *J. Hydrol.*, 308, 302-312, 2005.

13 Marshall, L., Sharma, A., and Nott, D. J.: Modelling the Catchment via Mixtures: Issues of
14 Model Specification and Validation, *Water Resour. Res.*, 42, W11409,
15 doi:10.1029/2005WR004613, 2006.

16 Moll, J. R.: Real time flood forecasting on the River Rhine, in: *Proceedings of the Hamburg*
17 *Symposium on Scientific Procedures Applied to the Planning, Design and Management of*
18 *Water Resources Systems*, IAHS Publ. no. 147, 265-272, 1983.

19 Montanari, A. and Brath, A.: A stochastic approach for assessing the uncertainty of rainfall-
20 runoff simulations. *Water Resour. Res.*, 42, 40(1), W01106, 2004.

21 Nash, J. and Sutcliffe, J.: River flow forecasting through conceptual models part I — A
22 discussion of principles, *J. Hydrol.* 10(3), 282-290, 1970.

23 Pappenberger, F., Matgen, P., Beven, K. J., Henry, J. B., Pfister, L., and De Fraipont, P.:
24 Influence of uncertain boundary conditions and model structure on flood inundation
25 predictions, *Adv. Water Resour.*, 29, 1430–1449, 2006.

26 Petersen-Overleir, A., Soot, A., and Reitan, T.: Bayesian Rating Curve Inference as a
27 Streamflow Data Quality Assessment Tool, *Water Resour. Manage.*, 23(9), 1835-1842, 2009.

28 Renard, B., Kavetski, D., Kuczera, G., Thyer, M., and Franks, S. W.: Understanding predictive
29 uncertainty in hydrologic modeling: The challenge of identifying input and structural errors,
30 *Water Resour. Res.*, 46, W05521, doi:10.1029/2009WR008328, 2010.

- 1 Roald, L. A., Skaugen, T. E., Beldring, S., Væringstad, Th., Engeset, R., and Førland, E. J.:
2 Scenarios of annual and seasonal runoff for Norway based on climate scenarios for 2030-49,
3 met.no Report 19/02 KLIMA, 2002.
- 4 Serban, P. and Askew A.J.: Hydrological forecasting and updating procedures, Hydrology for
5 the Water Management of Large River Basins, IAHS Publ. n. 201, 357- 369, 1991.
- 6 Shamseldin, A.Y. and O'Connor, K.M.: A non-linear neural network technique for updating of
7 river flow forecasts, Hydrol. Earth Syst. Sc., 5(4), 577-597, 2001.
- 8 Sharma, A., Luk, K. C., Cordery, I., and Lall, U.: Seasonal to interannual rainfall probabilistic
9 forecasts for improved water supply management: Part 2 - Predictor identification of quarterly
10 rainfall using ocean-atmosphere information, J. Hydrol., 239(1-4), 240-248, 2000.
- 11 Shrestha, D.L. and Solomatine, D.P.: Machine learning approaches for estimation of prediction
12 interval for the model output. Neural Networks, 19(2), 225-235, 2006.
- 13 Sikorska, A. E., Scheidegger, A., Banasik, K., and Rieckermann, J.: Considering rating curve
14 uncertainty in water level predictions, Hydrol. Earth Syst. Sci., 17, 4415–4427, 2013.
- 15 Smith, P. J., Beven, K. J., Weerts, A. H., and Leeda, D.: Adaptive correction of deterministic
16 models to produce probabilistic forecasts, Hydrol. Earth Syst. Sci., 16, 2783–2799, 2012.
- 17 Solomatine D. P. and Shrestha D. L.: A novel method to estimate model uncertainty using
18 machine Learning techniques. Water Resour. Res., 45, W00B11, 2009.
- 19 Todini, E.: Hydrological catchment modelling: past, present and future, Hydrol. Earth Syst. Sc.,
20 11(1), 468-482, 2007.
- 21 Toth, E., Brath, A., and Montanari A.: Real-time flood forecasting via combined use of
22 conceptual and stochastic models, Physics and Chemistry of the Earth, B, 24(7), 793-798, 1999.
- 23 World Meteorological Organization: Simulated real-time intercomparison of hydrological
24 models, WMO Pub., 241 pp, 1992.
- 25 Xiong, L. and O'Connor, K. M.: Comparison of four updating models for real-time river flow
26 forecasting, Hydrolog. Sci. J., 47(4), 621-639, 2002.
- 27 Xiong, L. H., Wan, M., Wei, X. J., and O'Connor, K. M.: Indices for assessing the prediction
28 bounds of hydrological models and application by generalised likelihood uncertainty
29 estimation. Hydrolog. Sci. J., 54(5), 852-871, 2009.

- 1 Xu, C-Y.: Statistical analysis of parameters and residuals of a conceptual water balance
- 2 model—methodology and case study. *Water Resour. Manage.*, 15, 75–92, 2001.
- 3

1 Table 1 Model parameters and corresponding optimized values.

Parameter	Description	Unit	Optimized value
Snow routine			
TX	Threshold temperature for rain/snow	[°C]	2.23
CX	Degree-day factor for snow melt (forest free part)	[mm/d°C]	9.95
CXF	Degree-day factor for snow melt (forested part)	[mm/d°C]	5.21
TS	Threshold for snow melt/freeze (forest free part)	[°C]	0.73
TSF	Threshold for snow melt/freeze (forested part)	[°C]	-1.80
CFR	Refreeze coefficient	[mm/d°C]	0.04
LW	Max relative portion liquid water in snow	[-]	0.085
Soil and evaporation routine			
FC	Field capacity	[mm]	306.87
FCDEL	Minimum soil moisture filling for POE	[-]	0.31
BETA	Non-linearity in soil water retention	[-]	3.84
INFMAX	Infiltration capacity	[mm/h]	30.22
Groundwater and response routine			
KUZ2	Outlet coefficient for quickest surface runoff	[1/day]	1.65
KUZ1	Outlet coefficient for quick surface runoff	[1/day]	0.99
KUZ	Outlet coefficient for slow surface runoff	[1/day]	0.42
KLZ	Outlet coefficient for groundwater runoff	[1/day]	0.09
PERC	Constant percolation rate to groundwater storage	[mm/day]	1.60
UZ2	Threshold between quickest and quick surface runoff	[mm]	122.34
UZ1	Threshold between quick and slow surface runoff	[mm]	49.97

2

1 Table 2 Summary of overall and seasonal performance of the conceptual model during the
 2 calibration (2001/02 to 2005/06) and validation (2006/07 to 2010/11) periods.

Seasons	Calibration period			Validation period		
	RMSE [mm]	RE [%]	NSE [-]	RMSE [mm]	RE [%]	NSE [-]
Overall	0.139	1	0.842	0.162	18.8	0.700
Autumn	0.147	1.8	0.724	0.147	11.3	0.769
Winter	0.182	-3.7	0.894	0.126	9.7	0.812
Spring	0.131	-2.7	0.709	0.246	24.6	0.509
Summer	0.073	28.2	0.641	0.079	38.2	0.592

3

1 Table 3 Ratio between occurrence frequency of low PVE ($\leq 10\%$) and high PVE ($> 10\%$) errors
 2 for the hydrologic years 2006/07-2010/11.

Data set	Overestimation				Underestimation			
	Aut.	Win.	Spr.	Sum.	Aut.	Win.	Spr.	Sum.
Simulated forecast (HBV model)	4.4	5.1	7.6	4.5	6.2	5.2	12.8	25.4
Forecast (complementary setup)	1.1	1.2	1.5	2.0	0.9	0.5	1.1	1.3

3

1 Table 4 Relative RMSE reductions (%) in reservoir inflows forecast as a function of forecast lead-time (* designates relative RMSE reduction
 2 of <0)

Season	Lead Time [hour]																								
	/year	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
Autumn	06/07	89.3	79.3	70.1	62.7	56.7	52.3	48.5	45	41.7	38.4	35	31.6	28.2	25.6	23.7	21.7	19.1	16.6	15.3	14.3	13.8	13	11.5	10.0
	07/08	91.6	84.4	78.6	73.5	67.6	62.2	58.0	53.8	50.7	48.0	44.8	41.4	38.8	36.3	33.8	30.7	26.3	19.5	10.9	3.3	*	*	*	*
	08/09	93.9	87.9	81.7	76.7	71.0	65.9	62.1	58.5	54.1	49.2	44	39.4	35.7	32.3	28.8	25.7	23.2	70	18.4	16.7	15.3	14.1	12.7	11.5
	09/10	90.9	83.2	76.9	70.9	64.7	59.1	54.9	51.0	47.2	44.2	41.1	38.1	35.1	30.0	29.5	27.1	25.1	23.3	21.9	70.0	70.0	10.0	19.1	18.4
	10/11	92.1	84.9	78.7	67.7	62.4	57	53.9	51.2	47.5	44.8	42.4	40.3	38	35.8	33.9	30.0	29.4	26.2	23.1	30.0	17.2	14.7	12.7	10.9
Winter	06/07	94.2	87.9	82.2	75.6	60.5	49.3	42.8	36.3	31.3	26.3	21.4	17.5	12.9	9.0	6.7	4.6	2.5	1.3	1.0	0.0	*	*	*	*
	07/08	91	81.9	73.3	66.2	59.9	54.1	49.2	44.8	40	36.1	33.3	30.8	28.1	25.4	23.2	90	19.5	17.5	15.6	15.5	16.5	17.5	18.1	18.4
	08/09	91.7	83.9	77.0	74.0	72.2	68.4	62.2	55.1	49.5	44.4	39.8	36	28.9	22.2	18.2	15.6	13.9	12.8	11.9	11.1	9.9	8.6	7.3	5.8
	09/10	94.9	91.4	87.3	83.5	80.3	78.8	76.7	72.7	65.9	58.1	51.8	46.9	43.4	40.2	37.7	35.5	33.7	32.2	30.9	29.4	27.8	26	24.1	22.2
	10/11	93.9	88.7	83.1	75.9	68.1	64.9	61.4	57.1	52.3	47	41.8	36.9	32.2	28.4	26	24.2	22.6	90	19.4	17.7	16	14.6	13	11.1
Spring	06/07	94.2	88.2	82.4	77	71.7	66.3	61.1	56.4	52.3	48.9	45.8	43.1	40.6	38.3	36	33.9	31.8	30	28.5	27.2	26.2	25.2	24.1	23.2
	07/08	96.6	93.3	89.8	86.2	82.6	79.0	75.6	72.8	70.4	68.4	66.6	64.9	63.1	61.3	59.4	57.6	55.8	54	52.5	51.1	49.7	48.4	47.1	46.0

	08/09	95	90.4	85.8	81.6	77.7	73.7	70.6	67.9	65.7	63.5	61.1	58.7	56.3	54	51.7	49.4	47	44.7	42.4	40.1	37.7	35.3	33.2	31.6
	09/10	93.9	87.7	81.7	76.0	70.6	64.9	59.3	54.4	50.6	47.4	44.8	42.5	40.4	38.5	36.8	35.2	33.9	32.8	30.0	31.3	30.5	29.7	29.0	28.3
	10/11	94.6	88.6	82.2	75.7	69.4	63.4	57.7	52.5	48.7	46.8	44.5	41.7	39.0	36.7	34.6	32.7	31.1	29.8	28.7	27.8	26.8	25.8	24.6	23.7
	06/07	94.8	90	85.7	82.8	80.1	76.3	72.6	69.7	67.4	66.0	65.1	63.7	60.1	58.2	56.3	54.2	51.6	49.6	47.6	44.9	42.2	39.5	36.8	34.4
	07/08	90.7	81.4	73.3	66.3	60.3	55.6	51.4	48.0	45.4	42.6	39.9	39.4	39.1	37.1	34.6	32.8	31.0	29.3	28.4	27.4	26.9	26.2	24.8	23.2
Summer	08/09	97.2	94.4	91.6	89	85.1	78.2	69.2	60.3	52.9	47.1	41.6	36.7	32.5	28.8	25.4	22.7	50.0	18.6	17.1	15.9	14.6	13.3	12.4	11.9
	09/10	92.4	84.8	79.1	76.2	74.2	71.5	68.4	65.2	61.0	57.1	54.3	51.9	50.0	47.7	45.1	43.0	41.1	39.3	37.0	35.8	35.0	34.1	33.2	30.0
	10/11	94.2	88.7	82.9	76.4	69.7	64.4	59.3	54.3	49.8	45.8	42.5	39.8	37.2	35.1	33.1	31.5	30.0	28.6	27.5	27.0	26.5	25.9	25.5	25.0


1

2

1 Table 5 Summary of seasonal containing ratio (95% prediction interval) during reservoir inflow forecasting (2006/07 to 2010/11)


Season	Lead Time [hour]																									
	/year	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	
Autumn	06/07	99.9	99.9	97.8	97.8	97.8	97.8	97.8	97.8	97.8	97.8	96.7	94.5	94.5	93.4	93.4	93.4	93.4	90.1	90.1	91.2	90.1	90.1	89.0	89.0	
	07/08	99.9	99.9	98.9	98.9	97.8	97.8	97.8	97.8	97.8	97.8	96.7	94.5	91.2	90.1	90.1	89	87.9	87.9	86.8	85.7	85.7	84.6	83.5	83.5	
	08/09	99.9	99.9	99.9	99.9	99.9	98.9	98.9	95.6	95.6	95.6	95.6	95.6	95.6	95.6	95.6	95.6	94.5	93.4	93.4	93.4	92.3	92.3	91.2	90.1	
	09/10	99.9	99.9	98.9	97.8	97.8	96.7	96.7	95.6	94.5	93.4	93.4	91.2	92.3	92.3	92.3	92.3	93.4	93.4	92.3	92.3	92.3	91.2	90.1	90.1	
	10/11	99.9	99.9	99.9	98.9	98.9	97.8	98.9	98.9	97.8	96.7	95.6	95.6	95.6	95.6	95.6	95.6	95.6	94.5	93.4	93.4	93.4	92.3	92.3	91.2	
Winter	06/07	99.9	99.9	99.9	99.9	97.8	96.7	96.7	95.6	95.6	95.6	95.6	95.6	94.4	94.4	93.3	93.3	92.2	92.2	92.2	92.2	91.1	91.1	91.1	90.0	
	07/08	99.9	99.9	98.9	97.8	97.8	97.8	97.8	97.8	96.7	96.7	94.5	93.4	93.4	92.3	94.5	94.5	94.5	95.6	96.7	95.6	95.6	95.6	94.5	94.5	
	08/09	99.9	99.9	99.9	99.9	98.9	98.9	98.9	97.8	97.8	97.8	97.8	97.8	97.8	95.6	95.6	95.6	95.6	94.4	94.4	94.4	94.4	94.4	95.6	95.6	
	09/10	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	97.8	97.8	97.8	97.8
	10/11	99.9	99.9	99.9	99.9	98.9	96.7	96.7	96.7	96.7	96.7	96.7	96.7	96.7	95.6	95.6	96.7	95.6	95.6	95.6	95.6	95.6	94.4	94.4	94.4	94.4
Spring	06/07	99.9	99.9	98.9	98.9	97.8	95.7	94.6	93.5	89.1	89.1	89.1	89.1	90.2	88.0	88.0	88.0	88.0	88.0	87.0	85.9	84.8	84.8	84.8	83.7	
	07/08	99.9	99.9	99.9	99.9	99.9	99.9	99.9	98.9	98.9	98.9	98.9	98.9	97.8	97.8	97.8	96.7	95.7	94.6	94.6	94.6	94.6	94.6	94.6	94.6	
	08/09	99.9	99.9	98.9	98.9	98.9	98.9	97.8	97.8	97.8	96.7	96.7	96.7	96.7	96.7	96.7	96.7	95.7	95.7	95.7	93.5	93.5	93.5	93.5	92.4	
	09/10	99.9	99.9	98.9	97.8	97.8	97.8	96.7	96.7	94.6	94.6	94.6	93.5	93.5	93.5	91.3	91.3	91.3	91.3	90.2	90.2	91.3	89.1	89.1	90.2	

	10/11	99.9	98.9	98.9	96.7	96.7	95.7	94.6	93.5	92.4	92.4	90.2	90.2	89.1	88	89.1	87	85.9	85.9	84.8	83.7	83.7	83.7	82.6	82.6	
	06/07	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	98.9	98.9	98.9	98.9	98.9	98.9	97.8	97.8	97.8	97.8	97.8
Summer	07/08	99.9	99.9	99.9	99.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9
	08/09	99.9	99.9	99.9	99.9	99.9	99.9	99.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9	98.9
	09/10	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	99.9	98.9	98.9	98.9	98.9	98.9
	10/11	99.9	99.9	99.9	99.9	98.9	98.9	98.9	98.9	98.9	97.8	96.7	96.7	96.7	96.7	96.7	96.7	96.7	96.7	96.7	95.7	95.7	95.7	95.7	95.7	

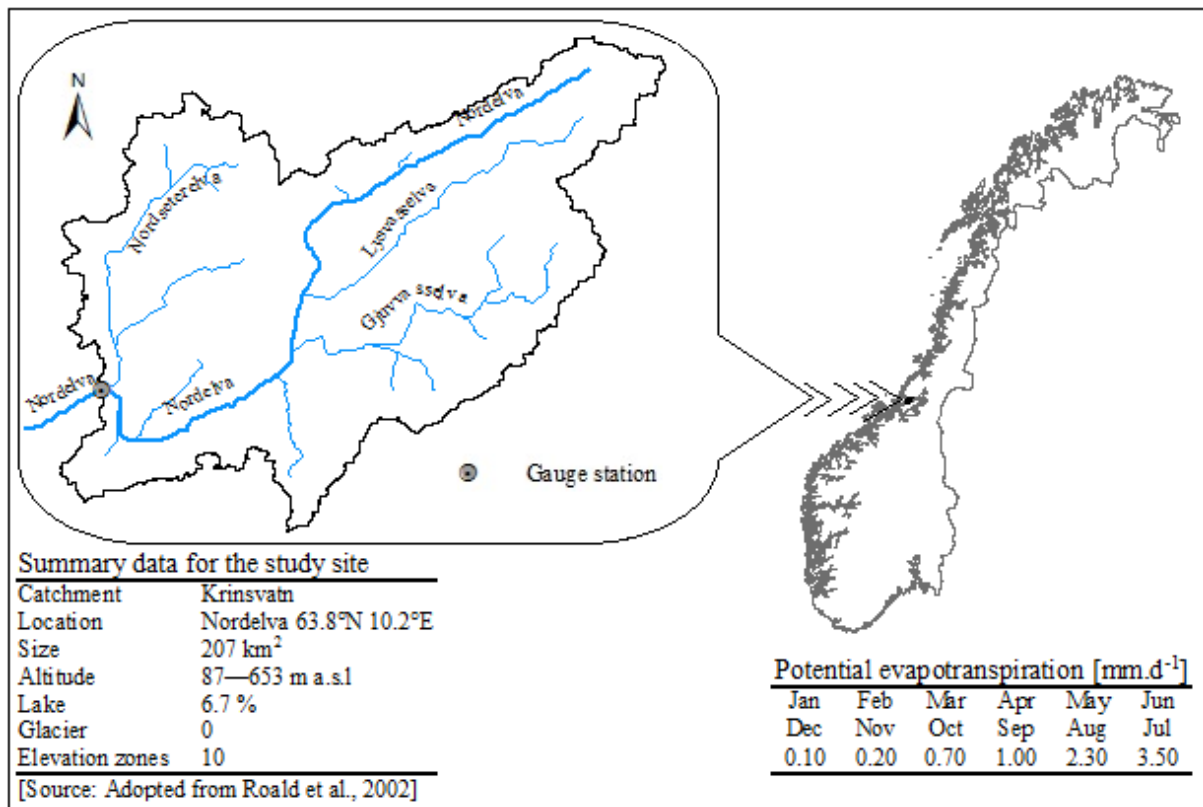

- 1
- 2
- 3
- 4

Figure 1. Location, characteristics and potential evapotranspiration estimates of the study catchment.

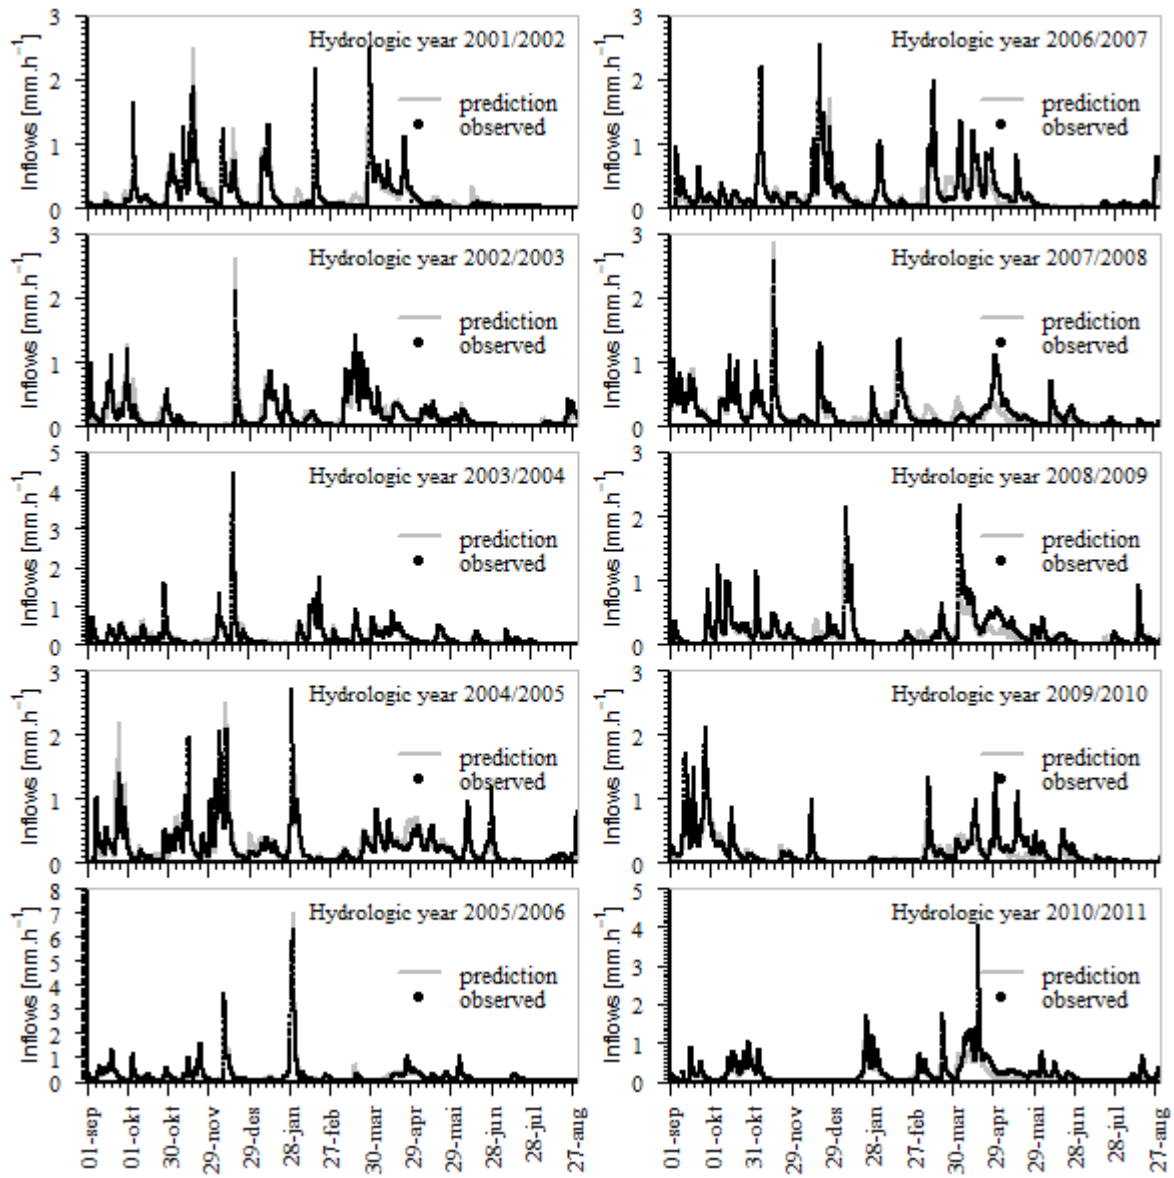


1

2

3 Figure 2. Observed and predicted reservoir inflow hydrographs during calibration (left column)


4 and validation (right column) of the conceptual model.

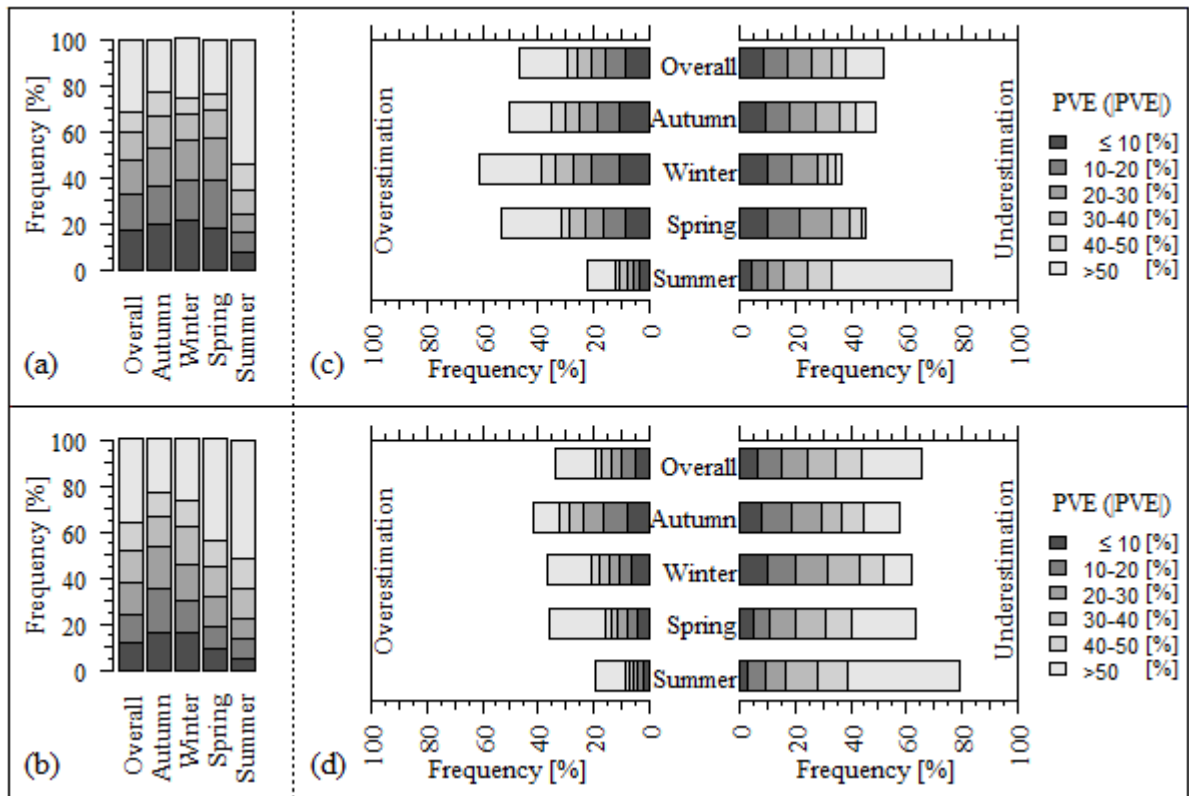

1


2

3 Figure 3. Stacked-column plots of: (1) PVE counts of the six absolute PVE classes ($\leq 10\%$, 10-
 4 20%, 20-30%, 30-40%, 40-50% and $>50\%$) during calibration (a) and validation (b); and (2)
 5 the fraction of times under- and over-estimation incidents corresponding to the six PVE classes
 6 occurred during calibration (c) and validation (d).

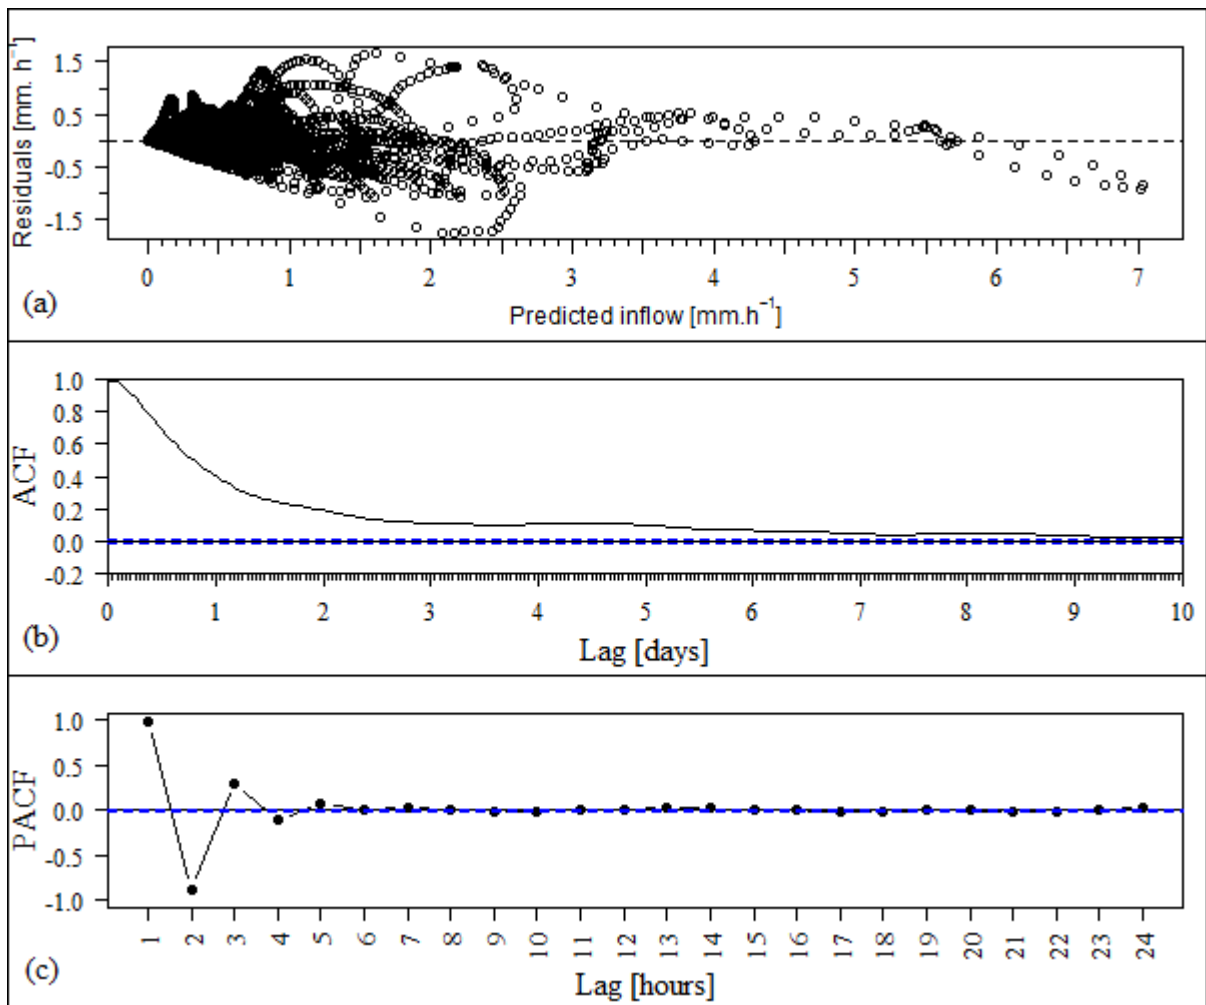

1
2


3 Figure 4. Plots of (a) residuals from the conceptual model as a function of predicted inflow
 4 during the calibration period, (b) autocorrelation function of the residuals, and (c) partial
 5 autocorrelation functions of the residuals.

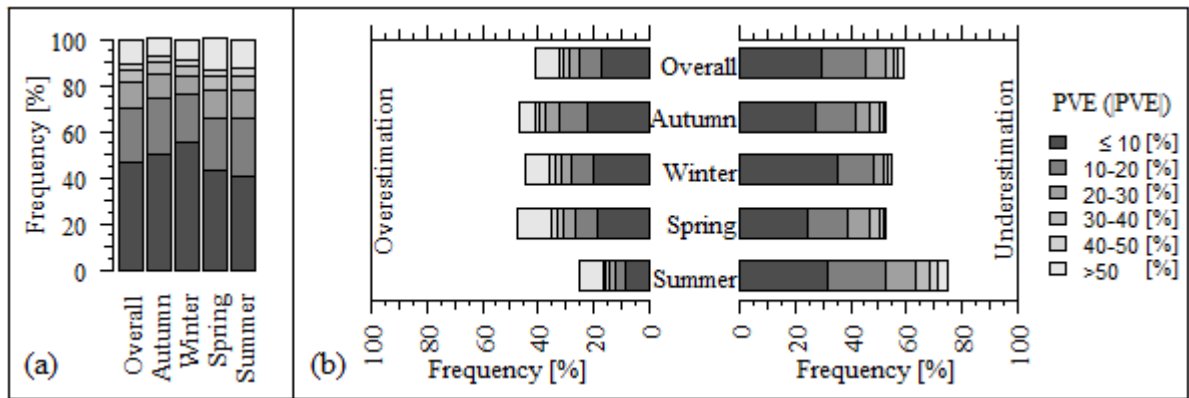

1

2


3 Figure 5. Stacked-column plots of: (a) PVE counts of the six absolute PVE classes ($\leq 10\%$, 10-
 4 20%, 20-30%, 30-40%, 40-50% and $>50\%$) observed in reservoir inflow forecasts from the
 5 complementary setup; and (b) the corresponding fraction of times under- and over-estimation
 6 incidents corresponding to the six PVE classes occurred. Hydrologic years 2006/07-2010/11.

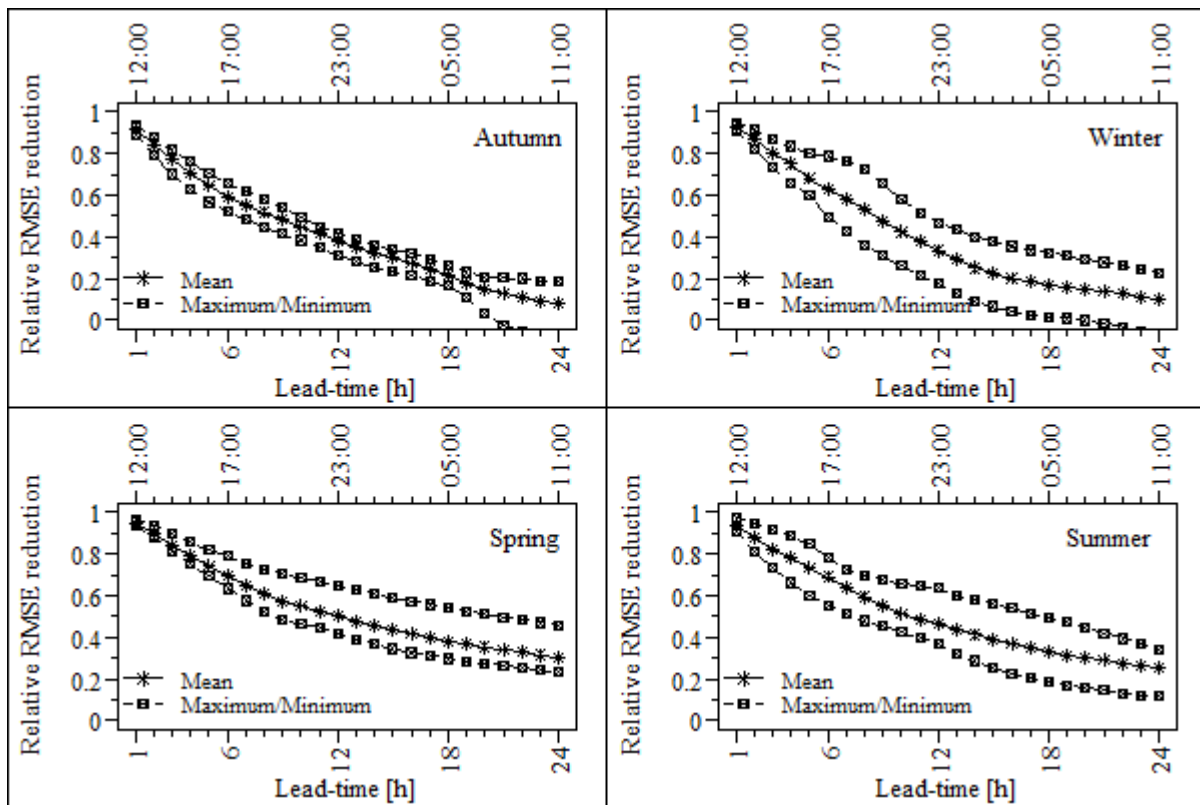

1


2

3 Figure 6. Summary of relative seasonal RMSE reductions as a function of forecast lead-time
 4 (minimum, mean and maximum values computed from corresponding computations for
 5 hydrologic years 2006/07 - 2010/11).

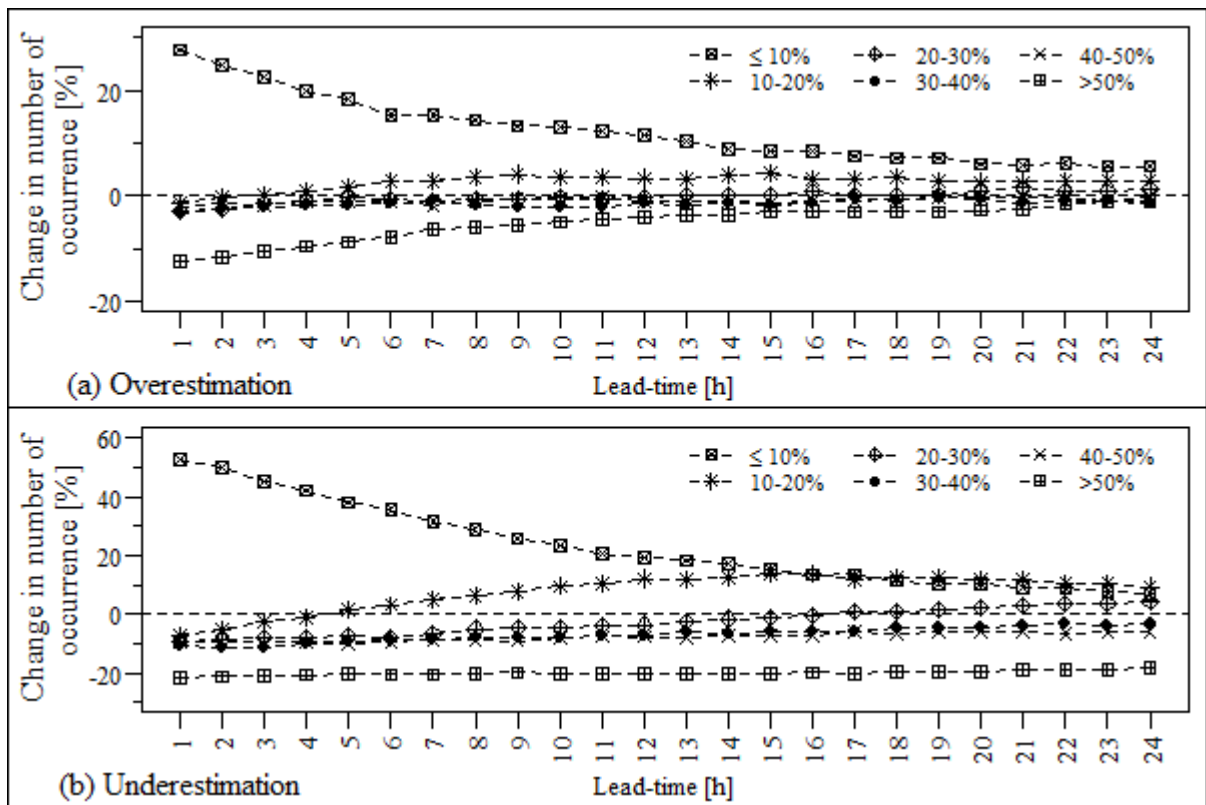

1
2
3
4
5


Figure 7. Change in number of occurrence of the six absolute PVE classes ($\leq 10\%$, 10-20%, 20-30%, 30-40%, 40-50% and $>50\%$) as a function of forecast lead-time: (a) overestimation and (b) underestimation.

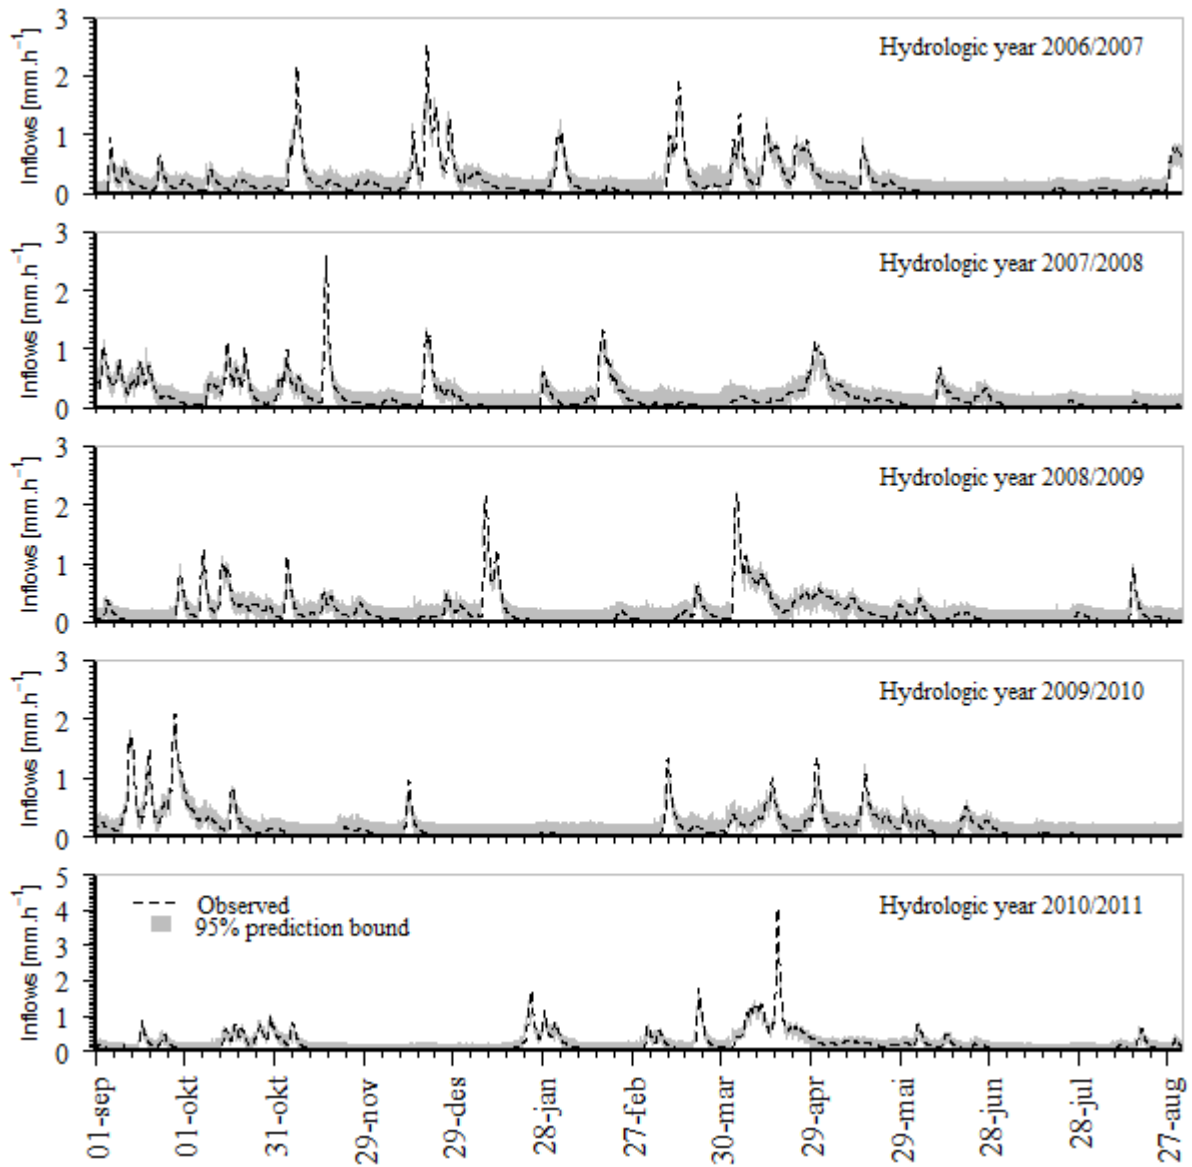

1

2

3 Figure 8. Observed hydrograph (broken lines) and the 95% prediction bound

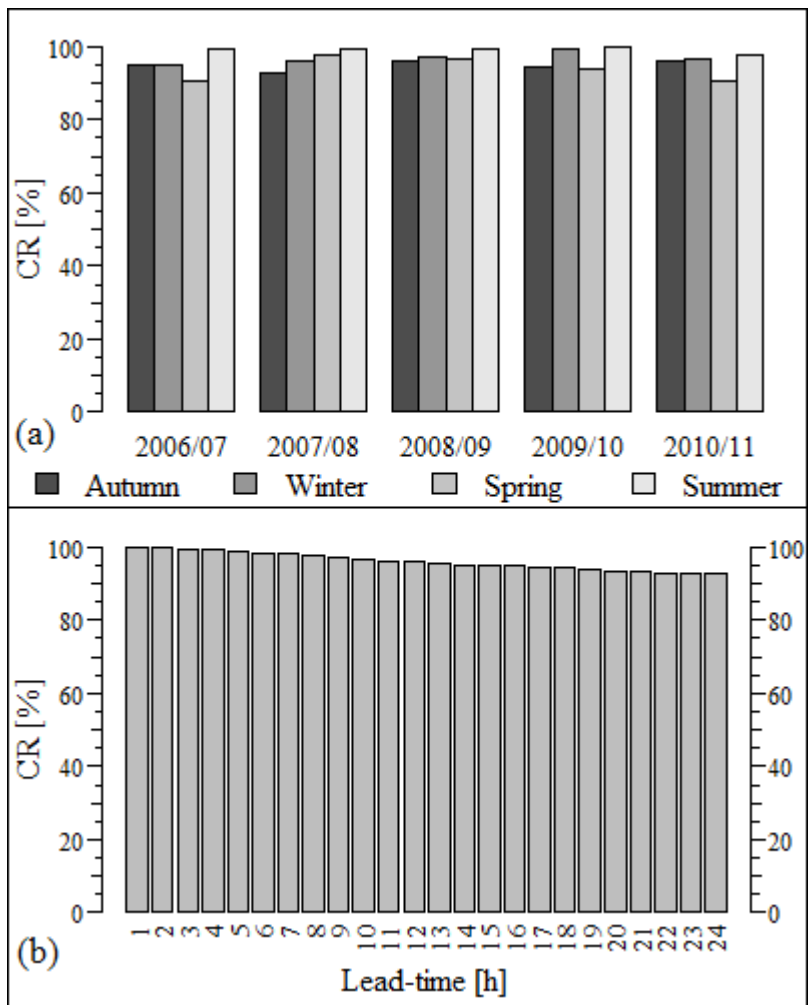

1

2

3 Figure 9. Reliability score (containing ratio-*CR*) for 95% prediction interval for: a) each
 4 season of every hydrologic year; and b) different forecast lead-times based on entire series.